CREED
1760

CONTRACTORS RESPONSIBILITES

THE CONTRACTOR IS BE RESPONSIBLE FOR FULL DESIGN CO-ORDINATION, BRACKETRY , SUPPORT WORK & BUILDERSWORK

INSTALL & CERTIFY THE WORKS IN ACCORDANCE WITH INDUSTRY STANDARDS, GOOD PRACTICE, HEALTH & SAFETY & BUILDING CONTROL REQUIREMENTS

THE CONTRACTOR SHALL SUBMIT RISK ASSESSMENTS AND METHOD STATEMENTS TO PROJECT MANAGER FOR ALL ELEMENTS OF THE WORKS PRIOR TO WORKS TAKING PLACE

THE CONTRACTOR SHALL SUBMIT DIMENSIONED WORKING DRAWINGS & TECHNICAL SUBMISSIONS TO PROJECT MANAGER FOR APPROVAL PRIOR TO PROCUREMENT & INSTALLATION

THE INFORMATION ON THIS DRAWING IS FOR SCOPE OF WORKS DESIGN DUTY PURPOSES ONLY.

READ ALL NOTES, SCHEDULES & INSTALLATION INSTRUCTIONS ON THIS DRAWING ALSO FORM THE WORKS SPECIFICATION, & MAY NOT BE REPEATED IN WRITTEN SPECS.

CONTRACTOR DUTIES - FULL DESIGN & INSTALL, WARRANTY, 1 YEARS DEFECTS, H&S COMPLIANCE, REGULATION COMPLIANCE

STUDIO OL3
ARCHITECTURAL DESIGN

NOTE:

ALLOW PWER CABLING FOR LIGHTING AS PER SUPPLIERS REQUIREMENTS


ALLOW FOR PWER ASSOCIATED WITH HVAC

ALLOW POWER AND CABLING FOR CCTV AS PER SUPPLIERS REQUIREMENTS

ALLOW FOR AND CABLING FOR SOUND SYSTEM AS PER SUPPLIERS REQUIREMENTS

ALLOW PWER AND CABLING FOR FIRE ALARM AS PER SUPPLIERS REQUIREMENTS

CONTAINMENT
THE ELECTRICAL CONTRACTOR / INSTALLER SHALL DESIGN / INSTALL / UTILIZE (Segregated) CONTAINMENT FOR ALL LIGHTIG / POWER / FIRE ALARM DATA CABLES & WIRING
CABLE & WIRING NOT WITHIN CONTAINMENT IS NOT ACCEPTABLE

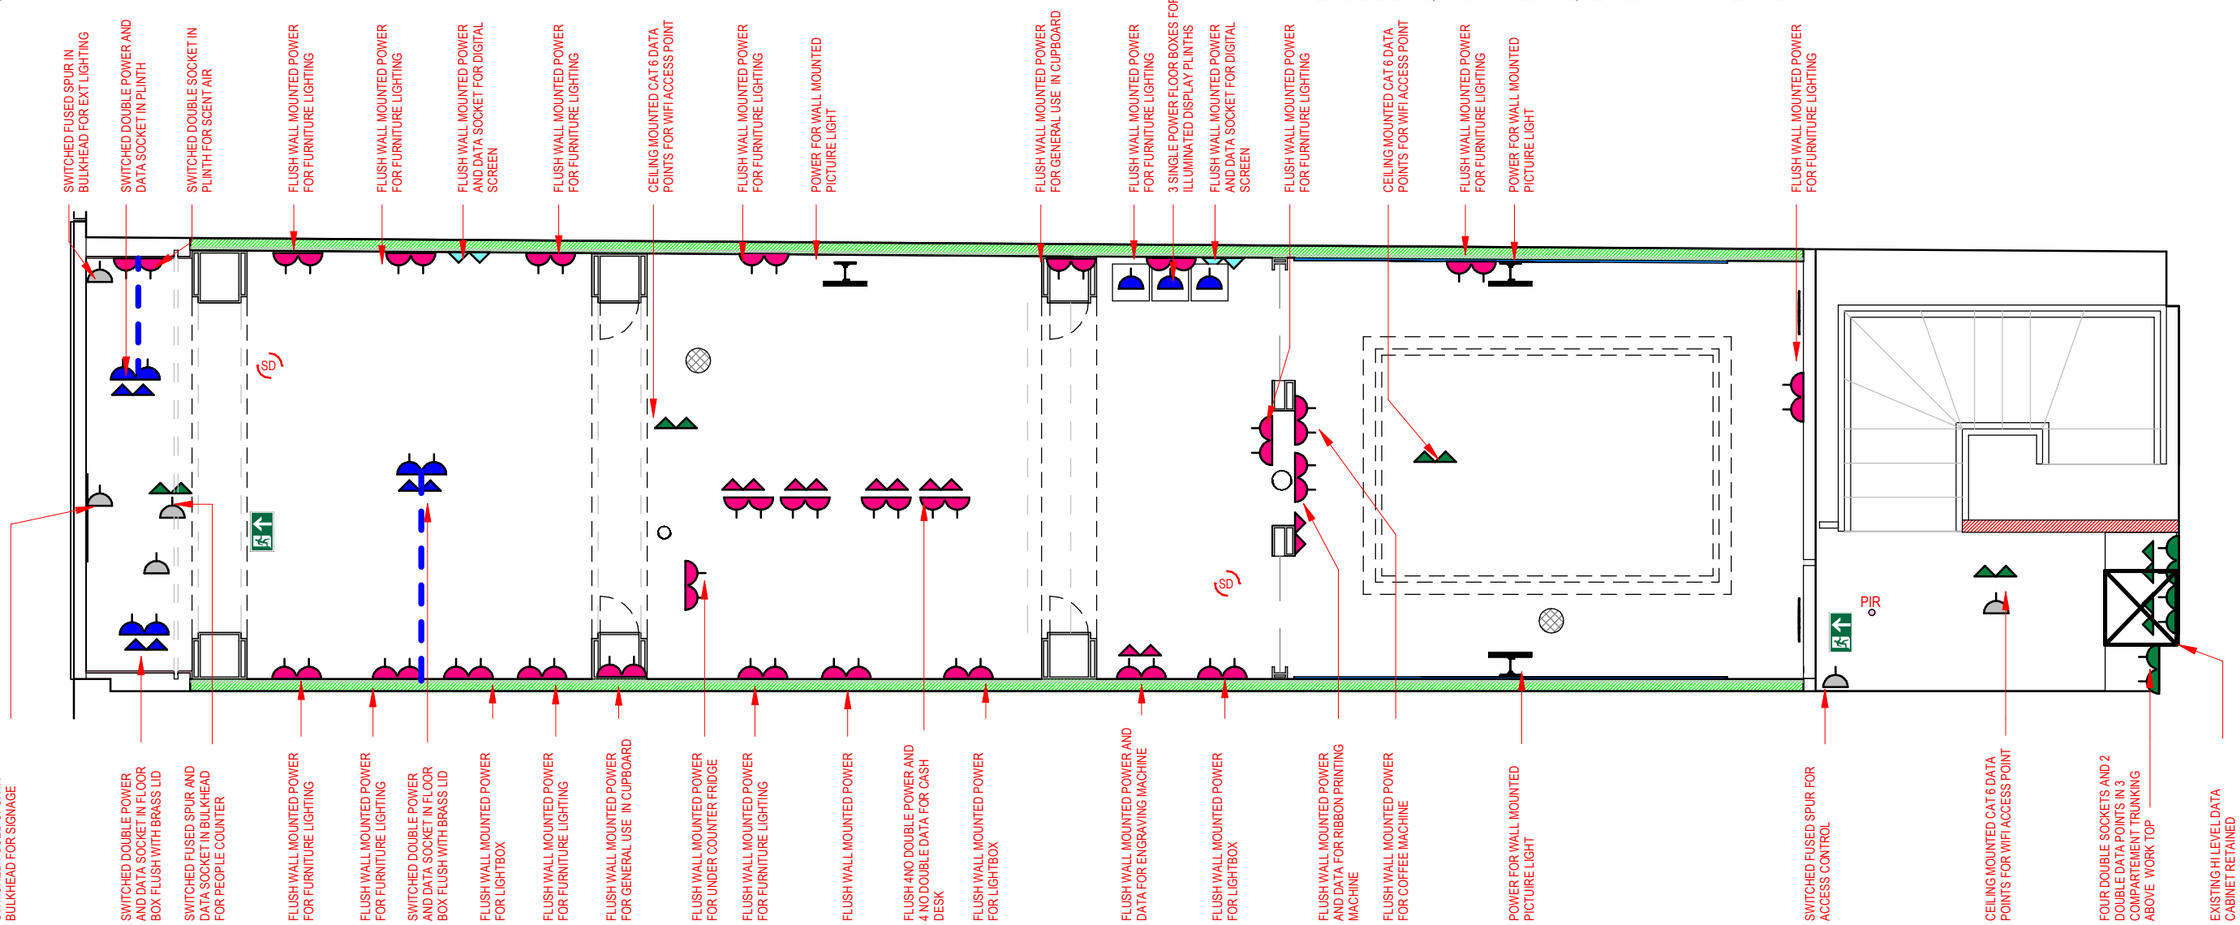

	Key				
RECESS FLUSH FLOOR QUAD W. FLUSH COVERPLATE LOCATION TO BE COORDINATE W/ MWK FINISHED IN BRASS		DOUBLE DATA IN RECESS FLUSH FLOOR QUAD W. FLUSH COVERPLATE LOCATION TO BE COORDINATE W/ MWK FINISHED IN BRASS		CEILING MOUNTED RECESSED SPEAKER	
RECESSED WALL-MTD SOCKET APPROX 1000mm AFFL		CEILING MOUNTED CAT 6 DATA SOCKET		360 DEGREE DOME CCTV CAMERA	
RECESSED LOW LEVEL WALL-MTD SOCKET APPROX 450mm AFFL		RECESSED LOW LEVEL WALL-MTD DATA SOCKET APPROX 450mm AFFL		SMOKE DETECTOR AND SOUNDER	SD
		HIGH LEVEL SURFACE-MTD SWITCHED FUSED SPUR		MXL EXIT SIGN SUSPENDED/SURFACE MOUNTED EMERGENCY EXIT SIGN WITH 3 HOUR BATTERY PACK AND LEGEND KIT. WHITE **ART NO:** MXL/ESA09/LFP	

INDICATES FLOOR CONTAINMENT FOR POWER AND DATA TO MID FLOOR SOCKETS

NOTE: GC SCOPE

GC TO CONFIRM EXISTING POWER & DATA LOCATIONS & RE-USE WHEREVER POSSIBLE. CONFIRM EXISTING MEETS REQUIREMENTS FOR NEW FIXTURES. RELOCATE AND INSTALL NEW AS NEEDED.

NOTE: MWC SCOPE

1. MWC MUST PROVIDE EXACT LOCATIONS OF ALL DEVICES TO GC PRIOR TO CONSTRUCTION.
2. POWER LOCATION MUST BE ACCURATELY LOCATED TO ALIGN WITH FIXTURES. MWC TO PROVIDE DIMENSIONED PLAN SHOWING ALL POWER LOCATIONS IN SHOP DRAWINGS SUBMITTAL.
3. MWC TO PROVIDE WHIPS AS REQ'D.

(1) DEDICATED P.O.S. CIRCUIT, (1) HOUSE POWER CIRCUIT, (1) COMBINED VOICE OVER IP/DATA

GC TO PULL ALL LOW VOLTAGE WIRING, PROVIDE HARD CONDUIT, & TERMINATE AT LL'S PANEL. LABEL AS "CHANEL" FOR IDENTIFICATION. REUSE (E) WHEREVER POSSIBLE.

No.	Description	Date