




2 (63) Room GF-032 North Section
1 : 50

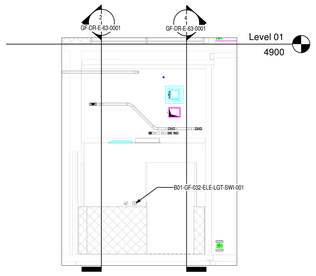


3 (63) Room GF-032 East Section
1 : 50

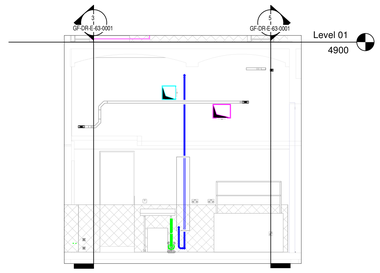


4 (63) Room GF-032 South Section
1 : 50

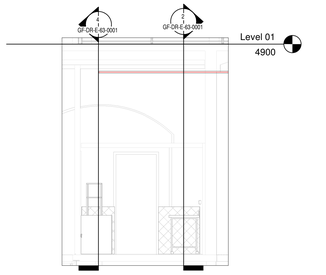


5 (63) Room GF-032 West Section
1 : 50

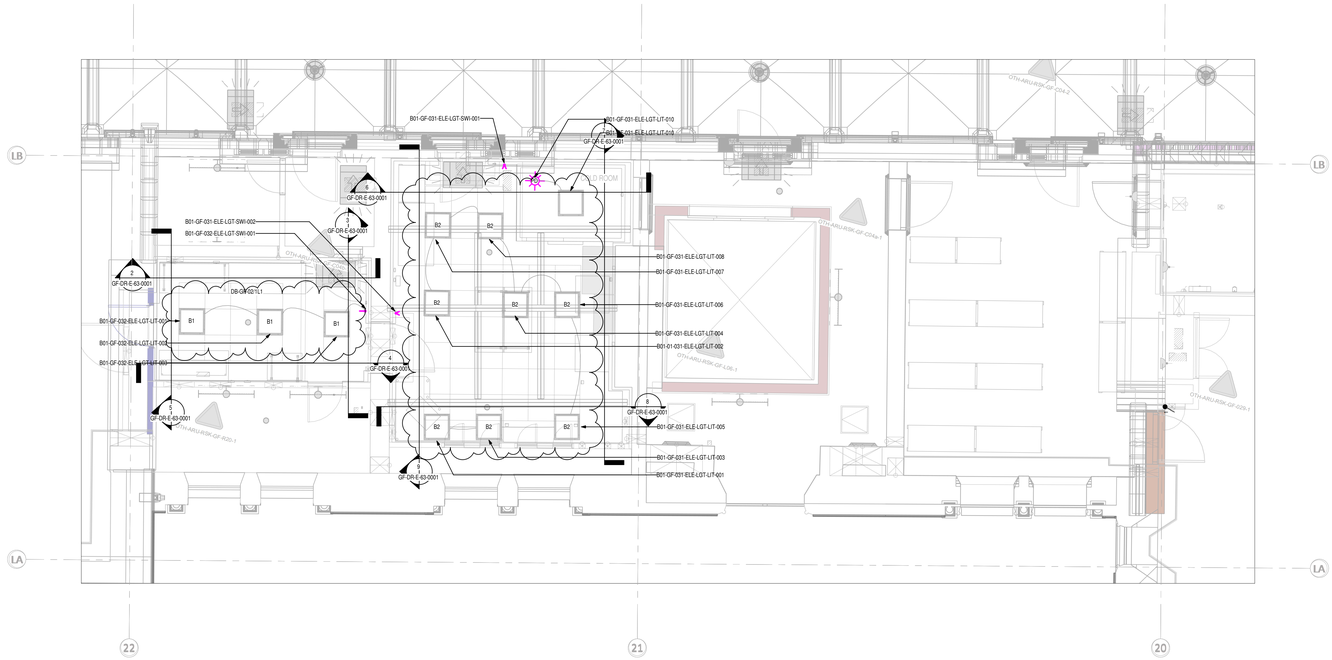


1 (63) Room GF-031 & Room GF-032
1 : 50

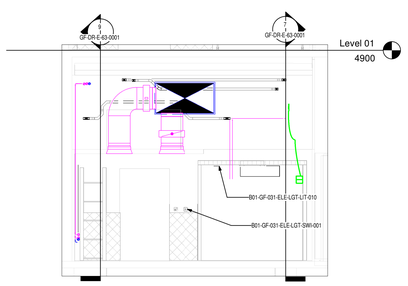


6 (63) Room GF-031 North Section
1 : 50

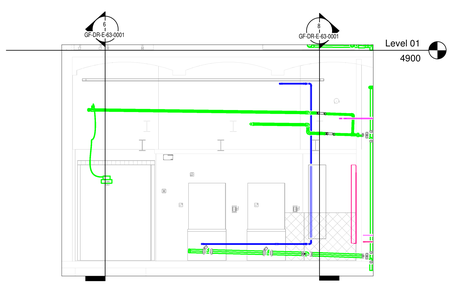

7 (63) Room GF-031 East Section
1 : 50

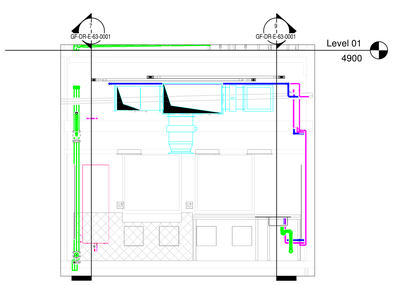

8 (63) Room GF-031 South Section
1 : 50

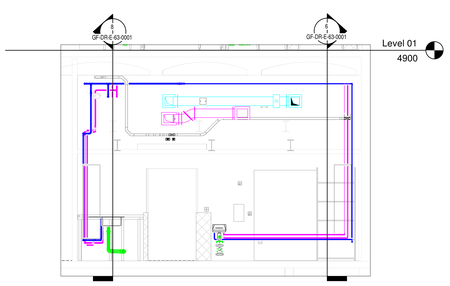

9 (63) Room GF-031 West Section
1 : 50

HK-N-60-General Notes

1 THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT PROJECT DRAWINGS AND INFORMATION FROM THE WHOLE PROJECT TEAM AS AVAILABLE ON ACONEX. THIS IS INCLUSIVE OF, BUT NOT LIMITED TO, ALL AVAILABLE 3D REVIT MODEL INFORMATION FROM HULLEY & KIRKWOOD, TAYLOR DESIGN, PURCELL, RAMBOLL AND ARUP.
2 ALL ELECTRICAL INSTALLATION WORKS SHALL BE INSTALLED IN ACCORDANCE WITH BS 7671 INCLUDING ALL AMENDMENTS.
3 CONTRACTORS SHALL INCLUDE FOR DISJOINTED WORKS INVOLVED WITH THE PROJECT IN REGARDS TO THE CO-ORDINATION WITH ALL OTHER TRADES.
4 THE ELECTRICAL INSTALLATION SHALL BE IN ACCORDANCE WITH THE CONTRACTORS PROGRAMME OF WORKS AND PHASING STRATEGY.
5 FINAL POSITIONS OF ALL EQUIPMENT SHALL BE AS PER THE SETTING OUT IN ACCORDANCE WITH THE ARCHITECTURAL INFORMATION.
6 THE CONTRACTOR SHALL UNDERTAKE ALL WORKS IN ACCORDANCE WITH THE ARUP PROJECT SPECIFICATION(S). IF NOT PROVIDED AT THE TIME OF TENDER, THE CONTRACTOR SHALL REQUEST SAID DOCUMENT(S) AND ENSURE THEIR TENDER COMPLIES FULLY WITH THE OUTLINES REQUIREMENTS.

HK-N-63-General Notes

1 SUFFIX 'E' ON DRAWING DENOTES THAT THE FITTING IS COMPLETE WITH 3 HOUR DURATION INTEGRAL BATTERY PACK, INVERTER AND LED INDICATOR TO MEET THE REQUIREMENTS OF BS 5266
2 FOR EMERGENCY EXIT SINAGE REFER TO ARUP LIGHTING DRAWINGS
3 ALL LUMINAIRES UTILISED SHALL BE SUITABLE FOR CATERING AREAS.
4 ALL ASSOCIATED EMERGENCY LIGHTING SHALL BE PROVIDED BY OTHERS AS AGREED WITH THE CLIENT TEAM.

LEGEND

A — WHITECROFT LIGHTING - ACL INDUSTRY
CEILING MOUNTED 1260mm LINEAR LED LUMINAIRE 25.4W, 3970lm, 4000K IP66.
MANUFACTURERS REFERENCE: ACH34K

B1 — WHITECROFT LIGHTING - HYGIENE LED
600 x 600 MODULAR RECESSED LED LUMINAIRE, 38W, 4101lm, 4000K IP54.
MANUFACTURERS REFERENCE: HYLHX04K

B2 — WHITECROFT LIGHTING - HYGIENE LED
600 x 600 MODULAR RECESSED LED LUMINAIRE, 29W, 3350lm, 4000K IP54.
MANUFACTURERS REFERENCE: HYLHX04K

1 WAY LIGHT SWITCH
(GANGED AS INDICATED)

2 WAY GANG LIGHT SWITCH
(GANGED AS INDICATED)

PASSIVE INFA-RED PRESENCE DETECTOR

03/09/2025	LIGHTING CHANGED TO SUIT CEILING GRID	C02	RV
07/11/2023	ISSUED FOR CONSTRUCTION	C01	S Much
02/08/2021	UPDATED IN LINE WITH CLASH REPORTS & COMMENTS	P05	J Staley
20/04/2021	ISSUED FOR TENDER	P04	J Staley
29/10/2020	ISSUED FOR WORK STAGE 5	P03	J Staley
30/08/2019	ISSUE FOR TENDER	P02	S Lu
27/08/2019	ISSUE FOR COMMENT	P01	S Lu
Date	Revison Description	Rev.	By

Revision Description

Manchester Office
2 Commercial Street
Castlefield
Manchester
M15 4RQ

T: 0161 832 2030
E: hk.manchester@hulley.co.uk

...Making Buildings Work

Project:
Manchester Town Hall Catering Works

Drawing Title:
LIGHTING LAYOUT LEVEL GF Sheet 1 of 2

Drawing Number:
OTH-HAK-TH-GF-DWG-V-6301

Revision:	C02	**Rev Date:**	03/09/2025
Scale:	1 : 50		
Drawn By:	J Staley	**Checked By:**	D Farrimond
		Approved By:	D Farrimond
Arch Rev:	-		
Struct Rev:	-		

Issue Status:
CONSTRUCTION

A0