
HK-N-60-General Notes

1 THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT PROJECT DRAWINGS AND INFORMATION FROM THE WHOLE PROJECT TEAM AS AVAILABLE ON ACONEX. THIS IS INCLUSIVE OF, BUT NOT LIMITED TO, ALL AVAILABLE 3D REVIT MODEL INFORMATION FROM HULLEY & KIRKWOOD, TAYLOR DESIGN, PURCELL, RAMBOLL AND ARUP.
2 THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL OTHER DOCUMENTATION RELATIVE TO THE PROJECT.
3 ALL ELECTRICAL INSTALLATION WORKS SHALL BE INSTALLED IN ACCORDANCE WITH BS 7671 INCLUDING ALL AMENDMENTS.
4 CONTRACTORS SHALL INCLUDE FOR DISJOINTED WORKS INVOLVED WITH THE PROJECT IN REGARDS TO THE CO-ORDINATION WITH ALL OTHER TRADES.
5 THE ELECTRICAL INSTALLATION SHALL BE IN ACCORDANCE WITH THE CONTACTORS PROGRAMME OF WORKS AND PHASING STRATEGY.
6 FINAL POSITIONS OF ALL EQUIPMENT SHALL BE AS PER THE SETTING OUT IN ACCORDANCE WITH THE ARCHITECTURAL INFORMATION.
7 THE CONTRACTOR SHALL UNDERTAKE ALL WORKS IN ACCORDANCE WITH THE ARUP PROJECT SPECIFICATION(S). IF NOT PROVIDED AT THE TIME OF TENDER, THE CONTRACTOR SHALL REQUEST SAID DOCUMENT(S) AND ENSURE THEIR TENDER COMPLIES FULLY WITH THE OUTLINED REQUIREMENTS.

HK-N-63-General Notes

1 SUFFIX 'E' ON DRAWING DENOTES THAT THE FITTING IS COMPLETE WITH 3 HOUR DURATION INTEGRAL BATTERY PACK, INVERTER AND LED INDICATOR TO MEET THE REQUIREMENTS OF BS 5266
2 FOR EMERGENCY EXIT SINAGE REFER TO ARUP LIGHTING DRAWINGS
3 ALL LUMINAIRES UTILISED SHALL BE SUITABLE FOR CATERING AREAS.

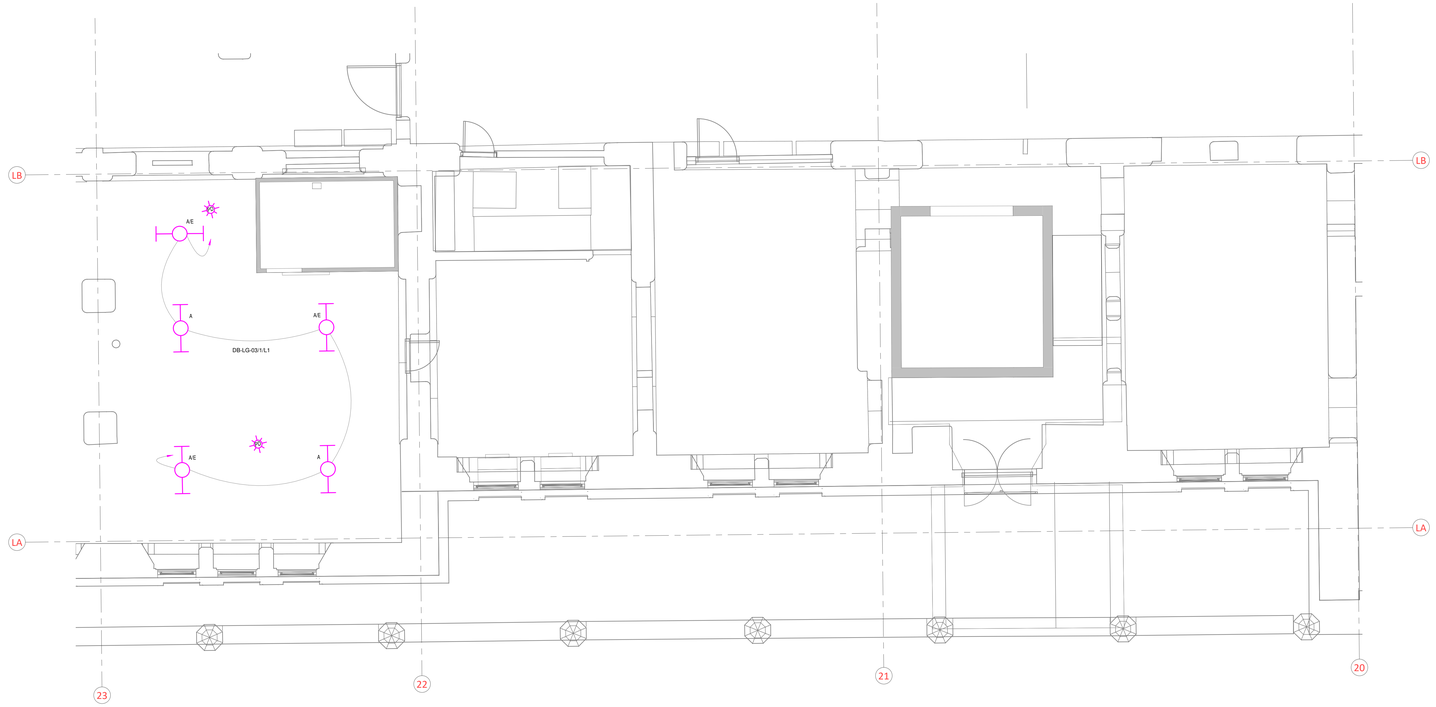

ROOM LG-035 & ROOM LG-036

Needs to be fully coordinated with Arup/Purcell

LEGEND

A — CEILING MOUNTED 1200mm LED BATTEN 4600lm, 4000K IP65. SUITABLE FOR CATERING AREAS.

A/E — CEILING MOUNTED 1200mm LED BATTEN 4600lm, 4000K IP65. SUITABLE FOR CATERING AREAS C/W 3hr EMERGENCY.

B — CEILING MOUNTED 1200mm ATEX CAT 3 LUMINAIRE 4600lm, 4000K IP65.

B/E — CEILING MOUNTED 1200mm ATEX CAT 3 LUMINAIRE 4600lm, 4000K C/W 3hr EMERGENCY.

1 WAY LIGHT SWITCH (GANGED AS INDICATED)

2 WAY GANG LIGHT SWITCH (GANGED AS INDICATED)

PASSIVE INFA-RED PRESENCE DETECTOR

Lendlease
Document Review
Lendlease document received on:
1. Accepted
2. Accepted with comments
3. Rejected
Lendlease Checked by: Joe Wren Lee
Date: 11/10/2019
Acceptance of documents or comment on the same should not relieve the Contractor of any obligations under the contract, nor does it relieve the designer from responsibilities for the design or compliance with all statutory obligations and responsibilities of the contract.

Date	Revision Description	Rev.	By
30/09/2019	ISSUE FOR TENDER	P02	S Lu
27/08/2019	ISSUE FOR COMMENT	P01	S Lu

Revision Description

hulley & kirkwood consulting engineers
...Making Buildings Work

Manchester Office
2 Commercial Street
Castlefield
Manchester
M15 4RQ

T: 0161 832 2030
E: hk.manchester@hulley.co.uk

Project:
Manchester Town Hall Catering Works

Drawing Title:
LIGHTING LAYOUT LEVEL LG

Drawing Number:
OTH-HAK-TH-LG-DWG-V-6301

Revision:	P02	**Rev Date:**	30/08/2019
Scale:	1 : 50		
Drawn By:	J Staley	**Checked By:**	D Farrimond
		Approved By:	D Farrimond
Arch Rev:	-		
Struct Rev:	-		

Issue Status:
TENDER

A0