

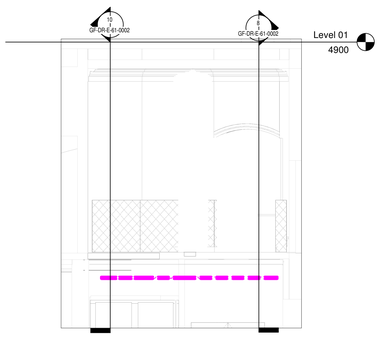



7 Room GF-C01k North Section
1 : 50

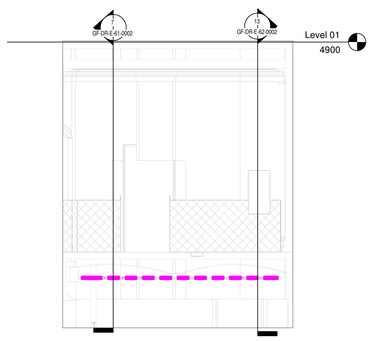


8 Room GF-C01k East Section
1 : 50

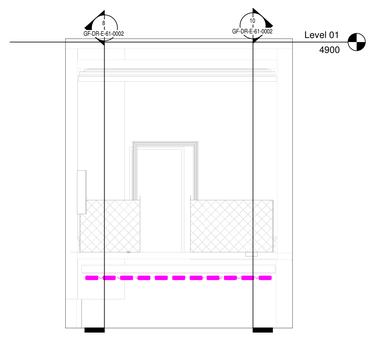


9 Room GF-C01k South Section
1 : 50

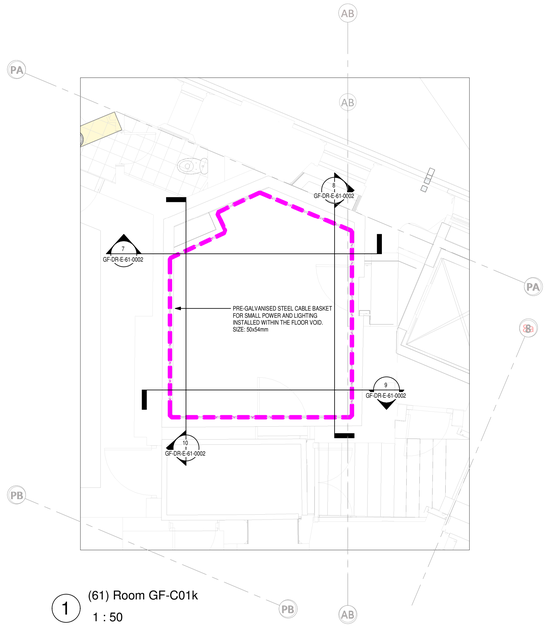

1 (61) Room GF-C01k
1 : 50

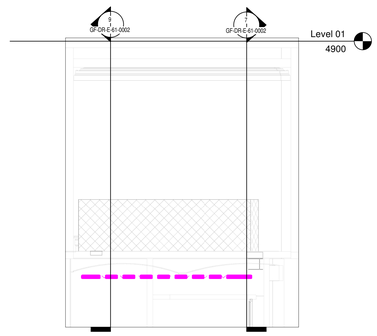

10 Room GF-C01kWest Section
1 : 50

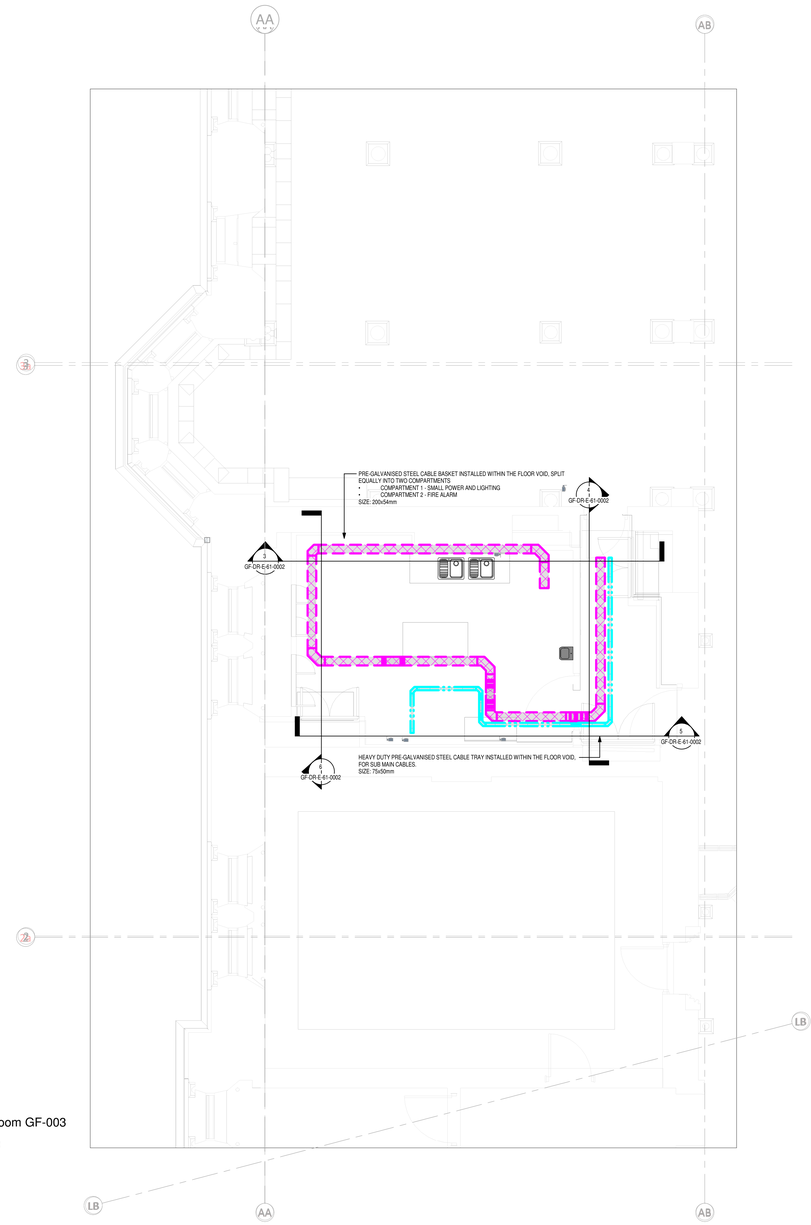


2 (61) Room GF-003
1 : 50

HK-N-60-General Notes


1. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT PROJECT DRAWINGS AND INFORMATION FROM THE WHOLE PROJECT TEAM AS AVAILABLE ON ACONEX. THIS IS INCLUSIVE OF, BUT NOT LIMITED TO, ALL AVAILABLE 3D REVIT MODEL INFORMATION FROM HULLEY & KIRKWOOD, TAYLOR DESIGN, PURCELL, RAMBOLL AND ARUP.
2. ALL ELECTRICAL INSTALLATION WORKS SHALL BE INSTALLED IN ACCORDANCE WITH BS 7671 INCLUDING ALL AMENDMENTS.
3. CONTRACTORS SHALL INCLUDE FOR DISJOINTED WORKS INVOLVED WITH THE PROJECT IN REGARDS TO THE CO-ORDINATION WITH ALL OTHER TRADES.
4. THE ELECTRICAL INSTALLATION SHALL BE IN ACCORDANCE WITH THE CONTRACTORS PROGRAMME OF WORKS AND PHASING STRATEGY.
5. FINAL POSITIONS OF ALL EQUIPMENT SHALL BE AS PER THE SETTING OUT IN ACCORDANCE WITH THE ARCHITECTURAL INFORMATION.
6. THE CONTRACTOR SHALL UNDERTAKE ALL WORKS IN ACCORDANCE WITH THE ARUP PROJECT SPECIFICATION(S). IF NOT PROVIDED AT THE TIME OF TENDER, THE CONTRACTOR SHALL REQUEST SAID DOCUMENT(S) AND ENSURE THEIR TENDER COMPLIES FULLY WITH THE OUTLINED REQUIREMENTS.

HK-N-61-General Notes

1. ALL CONTAINMENT SERVICES SHALL BE INSTALLED SUPPORTED FROM THE BUILDING STRUCTURE BY MEANS OF SUITABLY FABRICATED UNISTRUT/GRIDER CLAMPS TAKING INTO ACCOUNT BOTH THE CONTAINMENT AND CABLE WEIGHTS.
2. EACH SECTION OF CONTAINMENT SHALL BE ELECTRICALLY BONDED TO THE NEXT BY MEANS OF THE MANUFACTURERS EARTH BOND LUGS.
3. EACH PENERTRATION THROUGH FIRE RATED WALLS/SLABS ETC SHALL BE SEALED BY MEANS OF AN APPROVED FIRE RATED STOPPING MATERIAL.
4. ALL VERTICAL CONTAINMENT SERVICE SHALL BE AFFIXED TO THE BUILDING STRUCTURE VIA 25mm UNISTRUT MOUNTED HORIZONTALLY.
5. ALL HORIZONTAL BASKET SHALL BE INSTALLED WITH CABLE RETAINERS OF THE APPROPRIATE SIZE WITH A SPACING OF 300mm TO PREVENT CABLE SAG.
6. SOCKET OUTLET/FIRE ALARM SERVICE WITH A ROOM THAT DOES NOT HAVE A WHITEROCK WALL CLADDING FINISH THEN GALVANISED STEEL CONDUIT SHALL BE USED.
7. CONTRACTORS SHALL ENSURE ANY CABLING (DATA, FIRE ALARM AND FINAL CIRCUITS) ROUTED VIA STRAP FIXINGS ARE SUPPORTED BY NON-COMBUSTABLE MATERIALS.

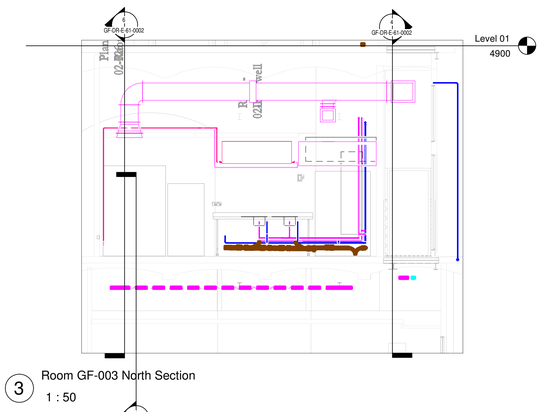


3 Room GF-003 North Section
1 : 50

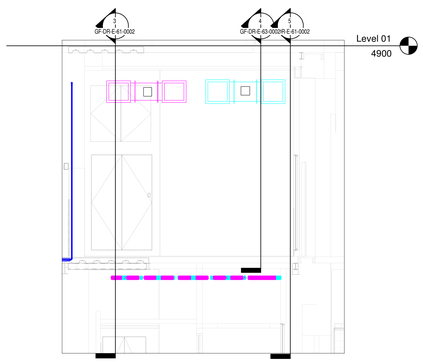

4 Room GF-003 East Section
1 : 50



5 Room GF-003 South Section
1 : 50

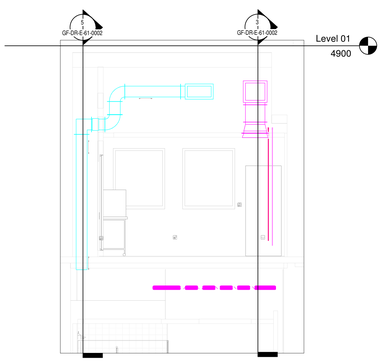

6 Room GF-003 West Section
1 : 50

03/09/2025	CONTAINMENT ROUTING AMENDED TO SUIT AMENDED DUCTS & AIR TERMINALS POSITIONING	C02	RV
07/11/2023	ISSUED FOR CONSTRUCTION	C01	S Main
02/08/2021	UPDATED IN LINE WITH CLASH REPORTS & COMMENTS	P05	J Staley
20/04/2021	ISSUED FOR TENDER	P04	J Staley
29/10/2020	ISSUED FOR WORK STAGE 5	P03	J Staley
30/08/2019	ISSUE FOR TENDER	P02	S Lu
27/08/2019	ISSUE FOR COMMENT	P01	S Lu
Date	Revision Description	Rev.	By

Revision Description

hulley & kirkwood consulting engineers

Manchester Office
2 Commercial Street
Castlefield
Manchester
M15 4RQ

T: 0161 832 2030
E: hk.manchester@hulley.co.uk

...Making Buildings Work

Project:
Manchester Town Hall Catering Works

Drawing Title:
CONTAINMENT LAYOUT LEVEL GF Sheet 2 of 2

Drawing Number:
OTH-HAK-TH-GF-DWG-V-6102

Revision:	C02	**Rev Date:**	03/09/2025
Scale:	1 : 50		
Drawn By:	J Staley	**Checked By:**	D Farrimond
		Approved By:	D Farrimond
Arch Rev:	-		
Struct Rev:	-		

Issue Status:
CONSTRUCTION

A0