




(2) (62) Room LG-036 North Section
1 : 50

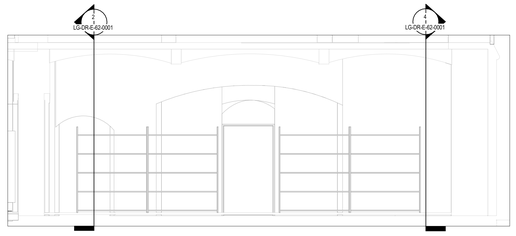


(3) (62) Room LG-036 East Section
1 : 50

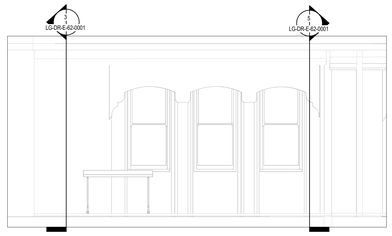

(4) (62) Room LG-036 South Section
1 : 50

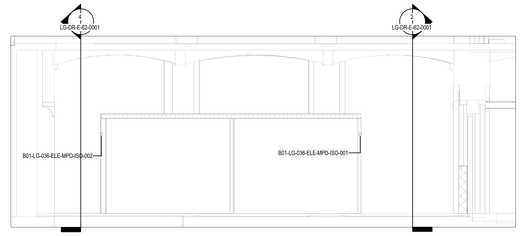

(5) (62) Room LG-036 West Section
1 : 50

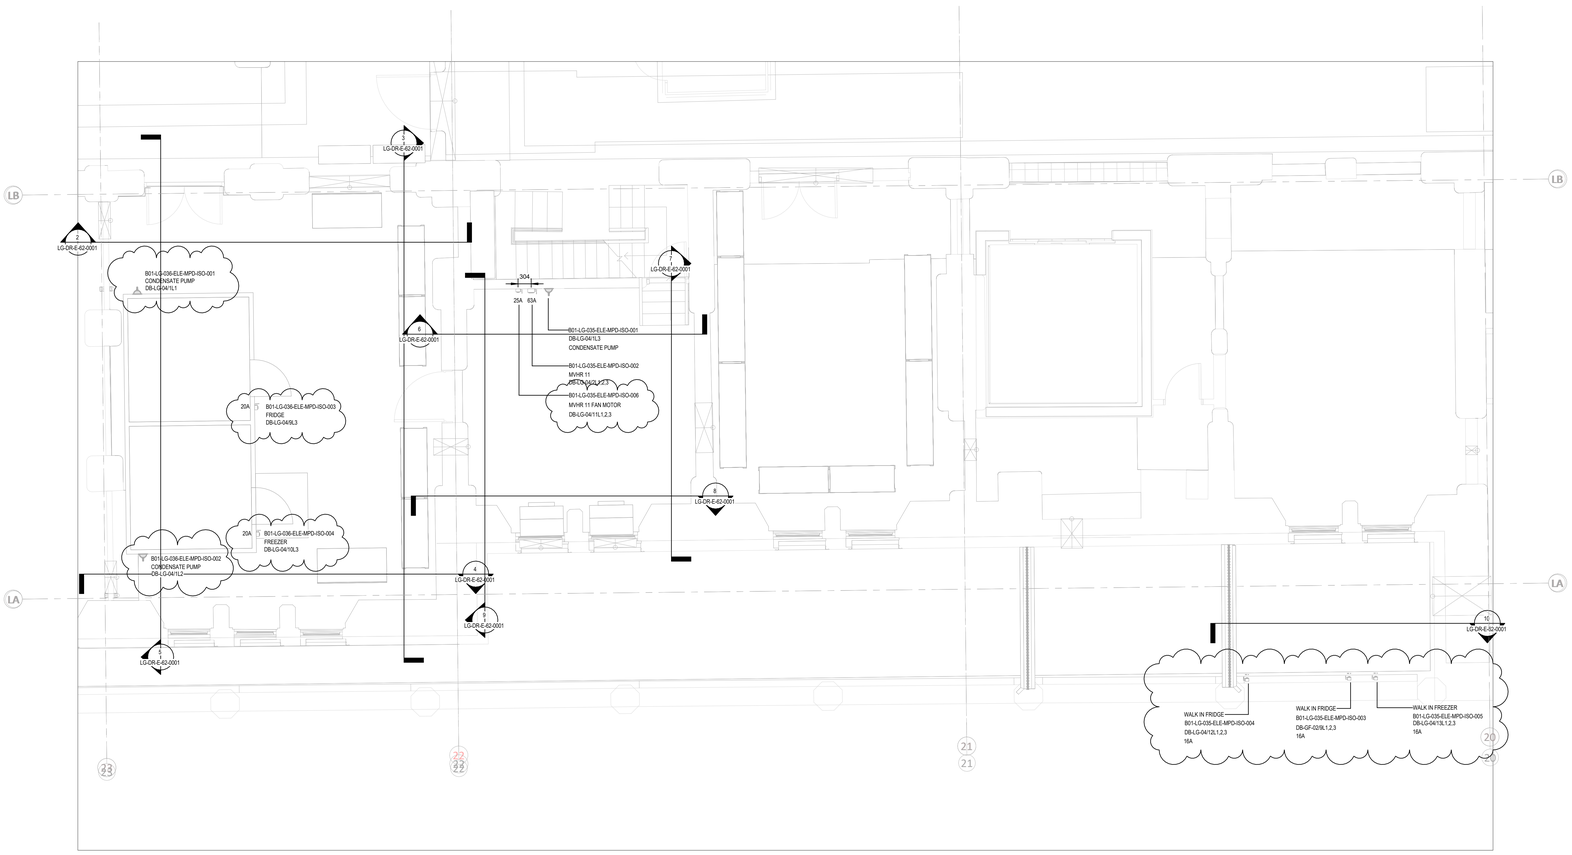

(10) (62) Under Walkway
1 : 50

(1) (62) Room LG-035 & Room LG-036
1 : 50

HK-N-60-General Notes

1. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT PROJECT DRAWINGS AND INFORMATION FROM THE WHOLE PROJECT TEAM AS AVAILABLE ON ACONEX. THIS IS INCLUSIVE OF, BUT NOT LIMITED TO, ALL AVAILABLE 3D REVIT MODEL INFORMATION FROM HULLEY & KIRKWOOD, TAYLOR DESIGN, PURCELL, RAMBOLL AND ARUP.
2. ALL ELECTRICAL INSTALLATION WORKS SHALL BE INSTALLED IN ACCORDANCE WITH BS 7671 INCLUDING ALL AMENDMENTS.
3. CONTRACTORS SHALL INCLUDE FOR DISJOINTED WORKS INVOLVED WITH THE PROJECT IN REGARDS TO THE CO-ORDINATION WITH ALL OTHER TRADES.
4. THE ELECTRICAL INSTALLATION SHALL BE IN ACCORDANCE WITH THE CONTRACTORS PROGRAMME OF WORKS AND PHASING STRATEGY
5. FINAL POSITIONS OF ALL EQUIPMENT SHALL BE AS PER THE SETTING OUT IN ACCORDANCE WITH THE ARCHITECTURAL INFORMATION.
6. THE CONTRACTOR SHALL UNDERTAKE ALL WORKS IN ACCORDANCE WITH THE ARUP PROJECT SPECIFICATION(S). IF NOT PROVIDED AT THE TIME OF TENDER, THE CONTRACTOR SHALL REQUEST SAID DOCUMENT(S) AND ENSURE THEIR TENDER COMPLIES FULLY WITH THE OUTLINED REQUIREMENTS.

HK-N-62-General Notes

1. THE CONTRACTOR SHALL ENSURE HIGH INTEGRITY EARTHING IS PROVIDED VIA DUAL EARTH CONNECTIONS AT THE DISTRIBUTION BOARDS.
2. UNDER NO CIRCUMSTANCES SHALL SERVICES BE INSTALLED ONTO ORIGINAL FABRIC WALLS WITHIN THE INTERNAL STRUCTURE.
3. ALL FLOOR MOUNTED CLEANER SOCKET OUTLETS SHALL BE INSTALLED WITHIN A FLOOR GROMMET COMPLETE WITH LID.
4. ALL DISTRIBUTION BOARDS ARE TO BE SUPPLIED AS PART OF THE BASE BUILD. CONTRACTORS SHALL REFER TO ARUP SMALL POWER DRAWINGS FOR LOCATIONS OF DISTRIBUTION BOARDS.

LEGEND

- 13A TWIN SWITCHED SOCKET OUTLET 'P' DENOTES IP66 RATED
- 13A SWITCHED FUSED CONNECTION OUTLET UNLESS STATED OTHERWISE 'HD' DENOTES HAND DRYER 'DP' DENOTES DOUBLE POLE UNFUSED ISOLATOR
- 13A SWITCHED SINGLE SOCKET 'CL' DENOTES CLEANERS SOCKET
- 13A SWITCHED 4 SINGLE SOCKET METALCLAD SUSPENDED SERVICE UNIT AS MANUFACTURED BY OLSON
- 13A UNSWITCHED SINGLE SOCKET OUTLET
- 1No COMMANDO SOCKET 32A SPBN
- FB — FLOOR BOX - 2No TWIN SWITCHED SOCKETS
- ROTARY ISOLATOR (SIZED AS INDICATED)
- 01 — SINGLE RJ45 OUTLET
- 02 — DOUBLE RJ45 OUTLET

Date	Revision Description	Rev.	By
04/06/2024	DB SCHEDULE UPDATE	C02	S Mish
07/11/2023	ISSUED FOR CONSTRUCTION	C01	S Mish
02/08/2021	UPDATED IN LINE WITH CLASH REPORTS & COMMENTS	P05	J Staley
20/04/2021	ISSUED FOR TENDER	P04	J Staley
29/10/2020	ISSUED FOR WORK STAGE 5	P03	J Staley
30/08/2019	ISSUE FOR TENDER	P02	S Lo
27/08/2019	ISSUE FOR COMMENT	P01	S Lo

Revision Description

hulley & kirkwood consulting engineers
...Making Buildings Work

Manchester Office
2 Commercial Street
Castlefield
Manchester
M15 4RQ

T: 0161 832 2030
E: hk.manchester@hulley.co.uk

Project:
Manchester Town Hall Catering Works


Drawing Title:
SMALL POWER & DATA LAYOUT LEVEL LG

Drawing Number:
OTH-HAK-TH-LG-DWG-V-6201


Revision:	C02	**Rev Date:**	04/06/2024
Scale:	1 : 50		
Drawn By:	J Staley	**Checked By:**	D Farrimond
		Approved By:	D Farrimond
Arch Rev:	-		
Struct Rev:	-		

Issue Status:
CONSTRUCTION


A0




(6) (62) Room LG-035 North Section
1 : 50



(7) (62) Room LG-035 East Section
1 : 50

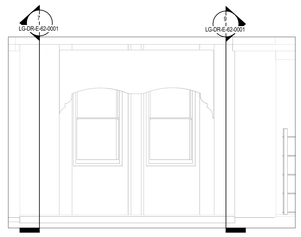

(8) (62) Room LG-035 South Section
1 : 50



(9) (62) Room LG-035 West Section
1 : 50