
THIS DRAWING IS INDICATIVE AND REPRESENTS ONLY THE DESIGN INTENT, THE CONTRACTOR MUST PRODUCE FULLY CO-ORDINATED WORKING/INSTALLATION DRAWINGS AS REFERRED TO IN THE CONTRACT DOCUMENTATION

NOTES

1. ALL ELECTRICAL WORKS SHALL COMPLY WITH THE 18TH EDITION IET WIRING REGULATIONS (BS 7671:2018) INCLUDING ALL CURRENT AMENDMENTS AND GUIDANCE NOTES AND THE CURRENT BUILDING STANDARDS (SCOTLAND) REGULATIONS.
2. ALL ELECTRICAL EQUIPMENT MOUNTING HEIGHTS AND LOCATIONS ARE TO BE CONFIRMED WITH THE ARCHITECT PRIOR TO INSTALLATION. HEIGHT OF ALL EQUIPMENT TO BE DDA COMPLIANT.
3. THIS DRAWING IS NOT TO BE SCALED, FIGURED DIMENSIONS ONLY TO BE TAKEN.
4. REFER TO ARCHITECT'S DRAWINGS FOR ALL SETTING OUT INFORMATION. NO DIMENSIONS SHALL BE MEASURED FROM THIS DRAWING.
5. CONTRACTOR TO ALLOW FOR COORDINATION OF ALL MECHANICAL AND ELECTRICAL SERVICES THROUGHOUT.
6. EXACT SUSPENSION AND MOUNTING HEIGHTS OF ALL LUMINAIRES ARE TO BE AGREED ON SITE BETWEEN ARCHITECT AND ENGINEERS PRIOR TO INSTALLATION.
7. EMERGENCY LIGHTING SHALL BE INSTALLED AND TESTED IN ACCORDANCE WITH BS 5266, ALL LATEST PART AND INCLUDING ALL CURRENT AMENDMENTS AND GUIDANCE NOTES.
8. REFERENCE SHALL BE MADE TO THE ELECTRICAL SPECIFICATION AND SCHEDULES FOR FULL DETAILS OF ALL PROPOSED LUMINAIRES.
9. THE ARTIFICIAL LIGHTING EFFICIENCY SHALL BE IN COMPLIANCE WITH SECTION 6.5.1 OF THE BUILDING STANDARDS.
10. WITH REFERENCE TO SECTION 6.7.1 OF THE BUILDING STANDARDS, THE SYSTEM IS TO BE FULLY TESTED AND COMMISSIONED PRIOR TO COMPLETION.
11. WITH REFERENCE TO SECTION 6.8.1 OF THE BUILDING STANDARDS, OPERATION AND MAINTENANCE MANUALS AND AS-FITTED DRAWINGS ARE TO BE PROVIDED PRIOR TO COMPLETION.
12. EMERGENCY LIGHTING TESTING SHALL BE BY MEANS OF MANUAL TEST KEY SWITCHES LOCATED ADJACENT TO LOCAL ELECTRICAL DISTRIBUTION BOARDS.

LEGEND

- 200 LUX
- 300 LUX
- 500 LUX
- MANUAL SWITCHING
- PRESENCE DETECTION
- DAYLIGHT DIMMING

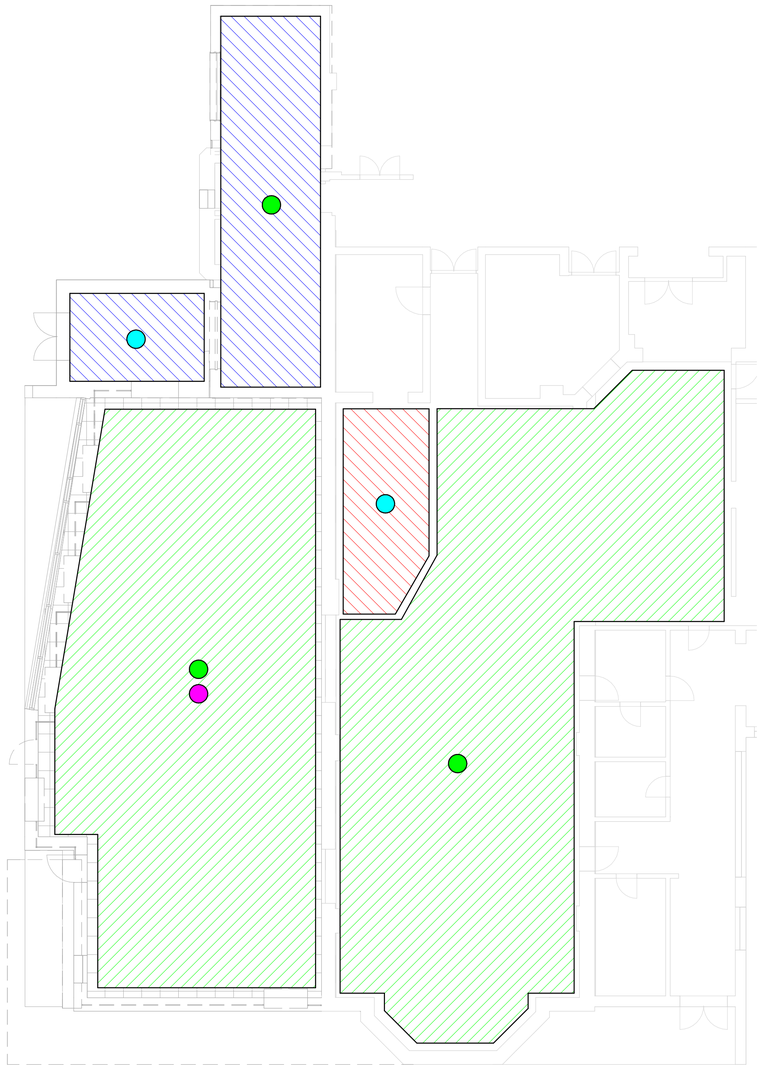

1 | 63 Lighting Ground Floor

SCALE : 1 : 100

REV	DESCRIPTION	BY	CHK	APP	DATE
P01	STAGE 2 ISSUE	LR	KD	KD	AUG 26

Project Status:

STAGE 2

ENGINEERING POWERED BY THE PAST
BUILDING THE FUTURE

HARLEY HADDOW

124-125 Princes Street
Edinburgh
EH2 4AD
T 44 (0) 131 226 3331
www.harleyhaddow.com

Project: 317321

NMGH GALLERY RESTAURANT AND SERVERY

Drawing Title:

PROPOSED LIGHTING STRATEGY

Scale: A1	Date:	Engineer:
1 : 100	AUG 2026	LR

317321-HAH-XX-XX-D-E-06310 | P01