
THIS DRAWING IS INDICATIVE AND REPRESENTS ONLY THE DESIGN INTENT, THE CONTRACTOR MUST PRODUCE FULLY CO-ORDINATED WORKING/INSTALLATION DRAWINGS AS REFERRED TO IN THE CONTRACT DOCUMENTATION

NOTES

1. DO NOT SCALE FROM THIS DRAWING.
2. ALL ELECTRICAL WORKS SHALL COMPLY WITH THE 18TH EDITION IET WIRING REGULATIONS (BS 7671:2018+A2:2022) INCLUDING ALL CURRENT AMENDMENTS AND GUIDANCE NOTES AND THE CURRENT BUILDING STANDARDS (SCOTLAND) REGULATIONS.
3. ALL ELECTRICAL EQUIPMENT MOUNTING HEIGHTS AND LOCATIONS ARE TO BE CONFIRMED WITH THE ARCHITECT PRIOR TO INSTALLATION. HEIGHT OF ALL EQUIPMENT TO BE DDA COMPLIANT.
4. REFER TO ARCHITECTS DRAWINGS FOR ALL SETTING OUT INFORMATION. NO DIMENSIONS SHALL BE MEASURED FROM THIS DRAWING.
5. CONTRACTOR TO MAKE ALLOWANCE FOR ALL NECESSARY SUPPLEMENTARY BONDING TO EQUIPMENT AS DETAILED IN THIS DRAWING IN COMPLIANCE WITH THE CURRENT EDITION 18TH EDITION IET WIRING REGULATIONS (BS 7671:2018). THE INSTALLATION SHALL COMPRISE CABLING, EARTH TAGS AND SUITABLE CABLE CLAMPS.
6. ALL CONDUITING, CONTAINMENT AND BACK BOXES TO FRONT OF HOUSE AREAS SHALL BE FULLY RECESSED WITH ALL ACCESSORIES FLUSH WITH WALL FINISHES. NO SURFACE CONDUIT SHALL BE ACCEPTED UNLESS APPROVED BY THE ARCHITECT. SURFACE MOUNTED ACCESSORIES AND CONDUIT CAN BE UTILISED IN BACK OF HOUSE AREAS (I.E. STORES, PLANT ROOMS, BIN STORES).
7. ELECTRICAL CONTRACTOR TO LIAISE WITH MECHANICAL CONTRACTOR FOR INSTALLATION OF SUPPLIES TO MECHANICAL CONTROL PANELS AND GENERAL MECHANICAL EQUIPMENT.
8. THE CONTRACTOR SHALL ENSURE THAT SOCKET OUTLETS AND ELECTRICAL ACCESSORIES ARE NOT INSTALLED BACK TO BACK TO ENSURE THE ACOUSTIC INTEGRITY OF THE WALLS ARE MAINTAINED.
9. CONTRACTOR TO ALLOW FOR SITE COORDINATION WITH OTHER TRADE/SERVICE INSTALLATIONS.
10. EVERY SERVICE, FITTING AND PIECE OF EQUIPMENT IS PROVIDED SO AS TO SERVE A PURPOSE OF THE BUILDING REGULATIONS AND IS TO BE DESIGNED, INSTALLED AND COMMISSIONED IN SUCH A WAY TO FULFIL THOSE PURPOSES.
11. THE CONTRACTOR SHALL CONSIDER THE USE OF ARC FAULT DETECTION DEVICES (AFDD) FOR ALL FINAL CIRCUITS AS RECOMMENDED IN THE 18TH EDITION IET WIRING REGULATIONS (BS 7671:2018).

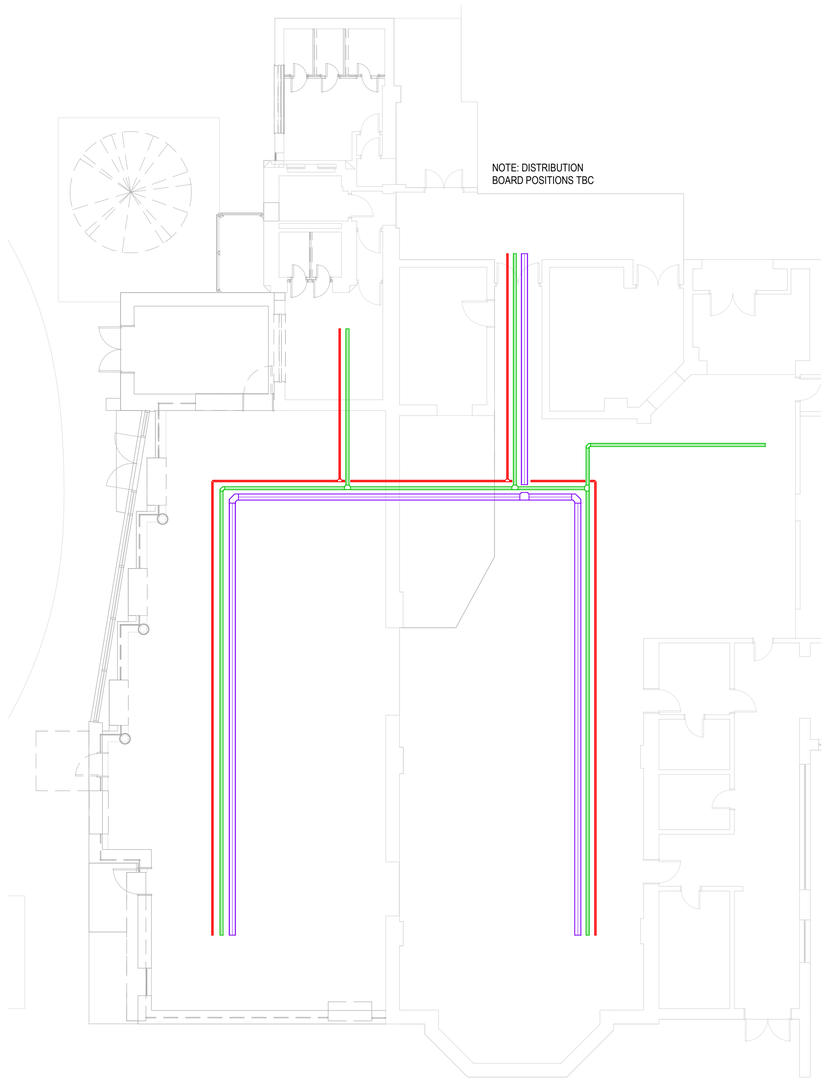

1 | 61 Containment Ground Floor

SCALE : 1 : 100

LEGEND

- SUB MAINS CABLE TRAY
- LIGHTING & POWER TRUNKING
- FIRE ALARM CABLE TRAY/BASKET
- DATA CABLE CABLE TRAY/BASKET
- DISTRIBUTION BOARD

REV	DESCRIPTION	BY	CHK	APP	DATE
P01	STAGE 2 ISSUE	LR	KD	KD	AUG 26

Project Status:

STAGE 2

ENGINEERING POWERED BY THE PAST
BUILDING THE FUTURE

HARLEY HADDOW

124-125 Princes Street
Edinburgh
EH2 4AD
T 44 (0) 131 226 3331
www.harleyhaddow.com

Project: 317321

NMGH GALLERY RESTAURANT AND SERVERY

Drawing Title:

PROPOSED CONTAINMENT STRATEGY

Scale: A1	Date:	Engineer:
1 : 100	AUG 2026	LR

317321-HAH-XX-XX-D-E-06110 | P01