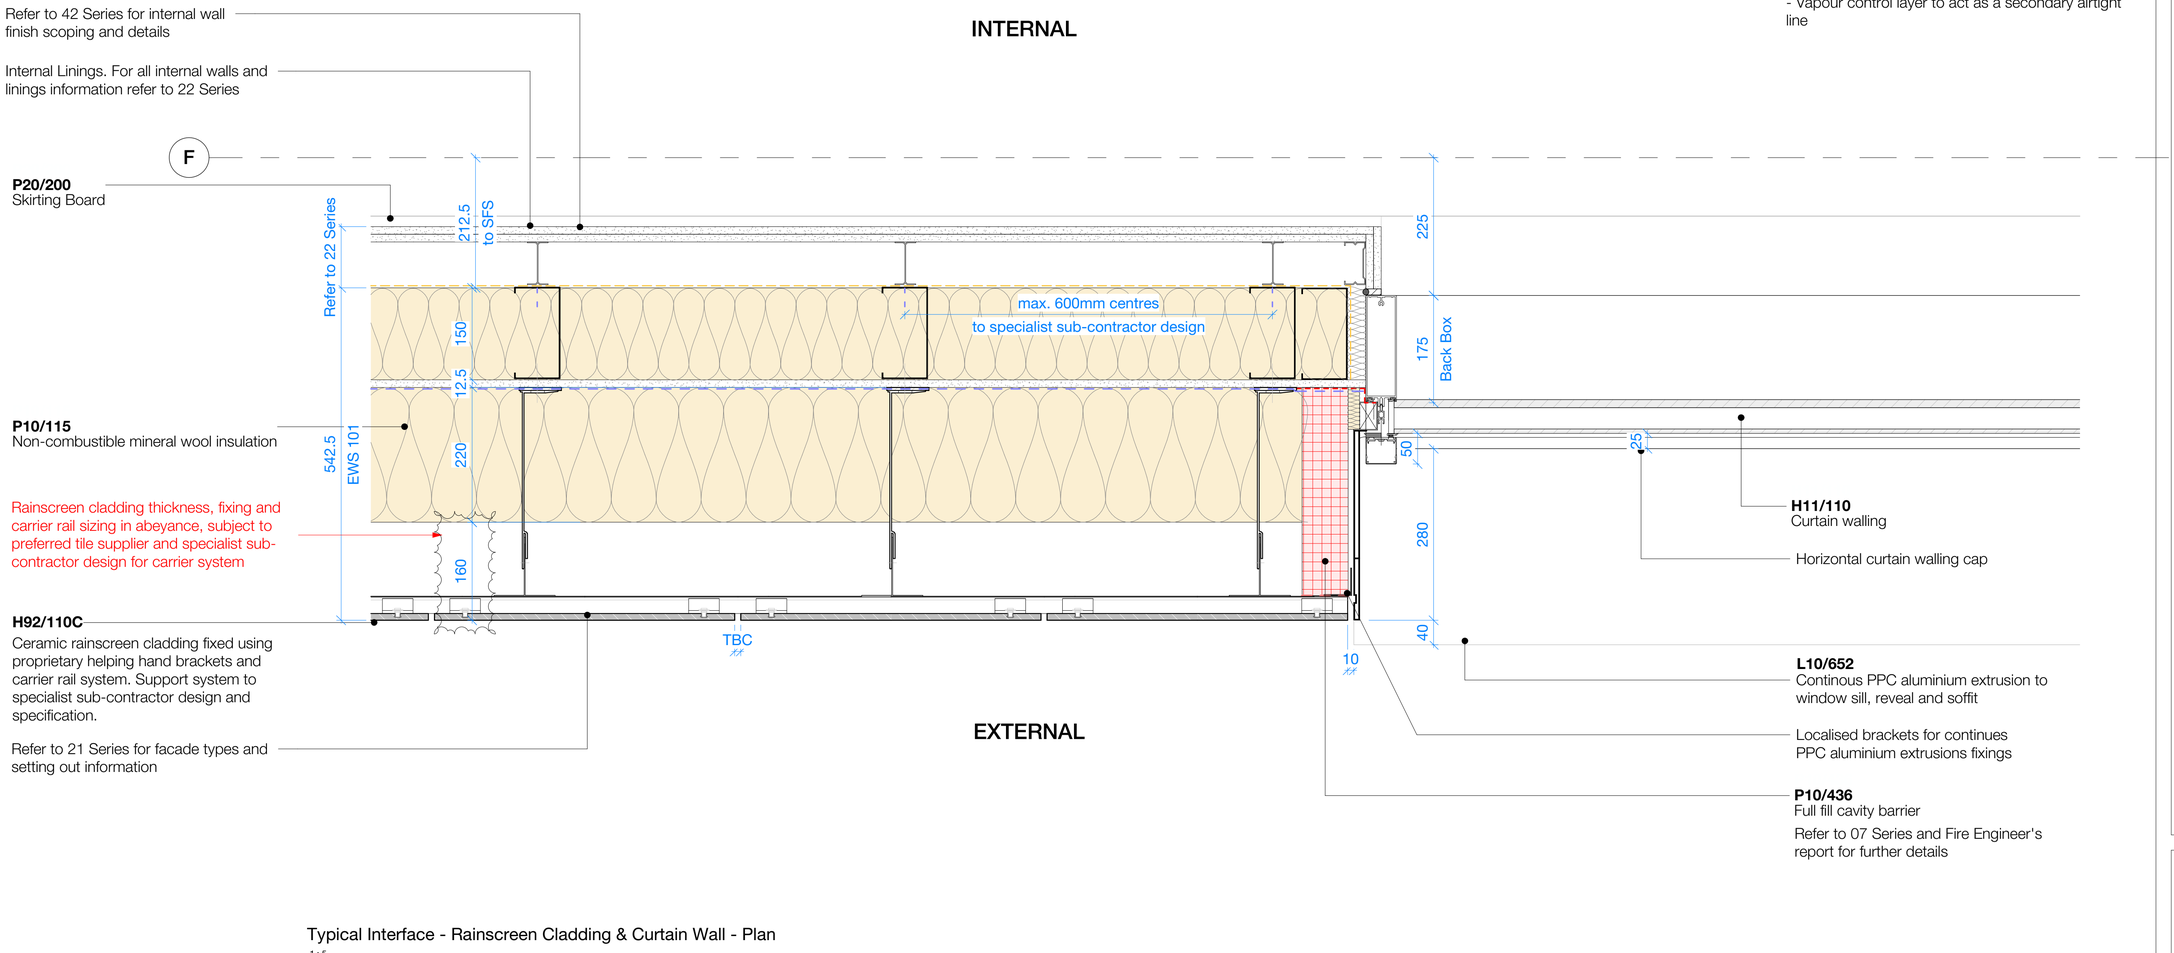


Typical Interface - Rainscreen Cladding & Curtain Wall - Plan

1 : 5

Minimum Target U-Value

(Refer to MEP thermal report)

Roof	0.10 W/m^{2}K
External Wall	0.22 W/m^{2}K
Curtain Wall	1.60 W/m^{2}K
Glazing w/frame	1.30 W/m^{2}K
Door	1.90 W/m^{2}K
Ground Floor	0.10 W/m^{2}K
Entrance Soffit	0.10 W/m^{2}K
Air Permeability	3 m3/h/m2 @ 50 Pa

Key:

- Vapour Control Layer (P10/310A)
- Breather Membrane (P10/320)
- Interface Sealing Membrane (P10/300)

Airtightness:

- Sheating board with taped joint and interface sealing membrane to act as primary airtight line
- Vapour control layer to act as a secondary airtight line

Copyright Hawkins\Brown Architects
No implied licence exists. This drawing should not be used to calculate areas for the purposes of valuation. Do not scale this drawing. All dimensions to be checked on the site by the contractor and such dimensions to be their responsibility. All work must comply with relevant British Standards and Building Regulations requirements. Drawing errors and omissions to be reported to the architect. To be read in conjunction with Architect's specification and other consultant information.

Status codes:

- S1 - Suitable for Coordination
- S2 - Suitable for Information
- S3 - Suitable for Review & Comment
- S4 - Suitable for Review & Authorization
- S5 - Suitable for Review & Acceptance
- An - Approved & Accepted as Stage complete

Rev	Description	Date
P1	Work Stage 4	25.02.2026
P2	Work Stage 4	25.03.2026
P3	Work Stage 4 Update	14.08.2026

26-28 Hilton Street
Manchester M1 2EH
mail@hawkinsbrown.com
hawkinsbrown.com

Hawkins\ Brown

Project
MANMET New Library

All Saints Campus
Manchester, M15 6BH

Drawing
Typical Plan Detail - Curtain Wall / Rainscreen Cladding Interface

Scale @ A1 1 : 5		**Date** 14.08.2026
Drawn By AD		**Checked By** MV
Job Number 240238	**Status** S4	**Purpose of Issue** Review & Authorisation
Drawing No. 1350B-HBA-XX-ZZ-DR-A-210752		**Rev** P3