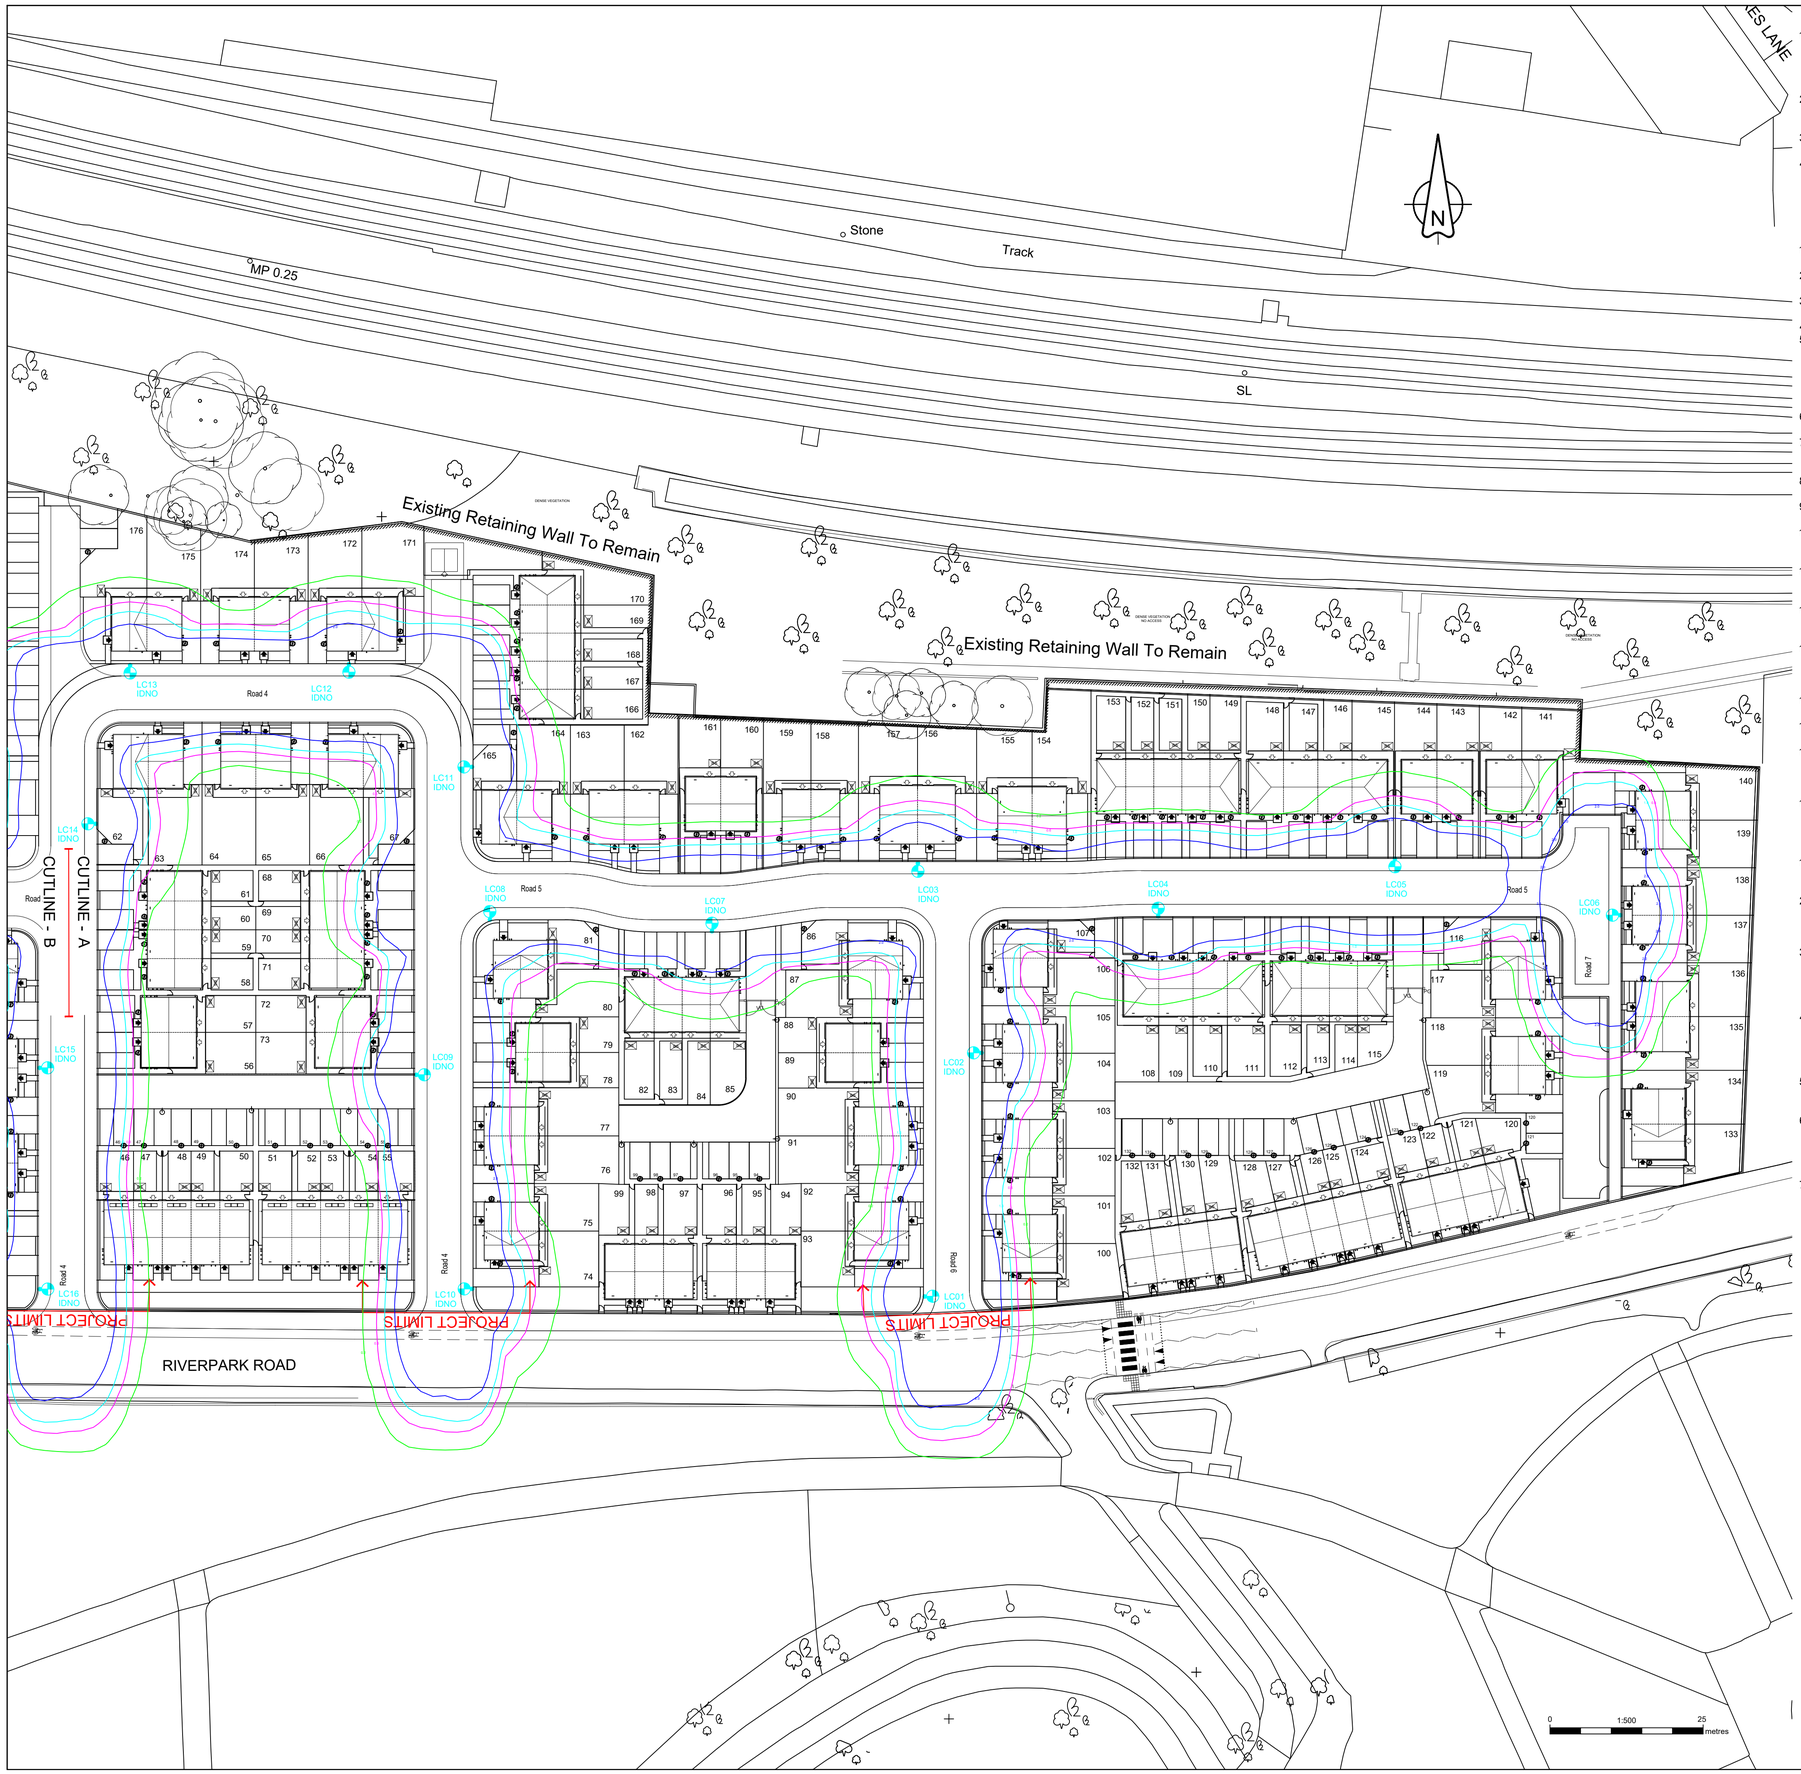


GENERAL NOTES

1. Before construction commences, the site engineer shall ensure that all design information is mutually compatible with all other drawings and documents provided by the overseeing organisation and all drawings and documents are to be read in conjunction with one another.
2. In the event of apparent ambiguity or contradiction, SHD Lighting Consultancy Ltd and the overseeing organisation shall be notified immediately.
3. SHD Lighting Consultancy Ltd accept no liability in the event of not being notified and where construction work has commenced.
4. This lighting design has been prepared in accordance with the HEMSA/HEA Guidance Note - CDM2015 Regulations, Issue 1.1 dated 09/04/15 - Procedure 2 and The Construction (Design and Management) Regulations 2015 - PART 3 Health and safety duties and roles - 9. Duties of designers.

NOTES

1. All works are to be carried out in accordance with the latest Manchester City Council street lighting specification.
2. Any inaccuracies are to be reported to the overseeing organisation or site engineer immediately.
3. The information on this drawing does not account for installation considerations, site conditions or provide any risk assessment.
4. No account is taken for the blocking effect caused by buildings,etc.
5. The planting of trees near to lighting columns is to be avoided as future growth may inhibit lighting levels. Due to the layout of the plots and associated driveways it is inevitable that there will be conflict with proposed landscaping features. Where such instances occur the lighting will take precedence in order to satisfy the requirements of the British standard.
6. The calculation shown by this drawing assumes that the whole area being considered is in the same plane.
7. The contractor shall liaise with the DNO in relation to the programming and coordination of any works associated with the connection and disconnection of street lighting equipment.
8. Final lighting column positions shall be agreed onsite with Manchester City Council street lighting engineer.
9. Final lighting column identification numbers shall be agreed with Manchester City Council street lighting engineer.
10. Any existing or proposed trees are to be cutback, removed or relocated elsewhere to avoid interference with the street lighting luminaire or prevent any future access or maintenance.
11. The contractor shall provide Manchester City Council with as-built drawings, test certificates and column and lantern data sheets in accordance with the Manchester City Council lighting specification.
12. Lighting column foundations shall be designed in accordance with the manufacturer datasheet's for the columns and soil types present (refer to Manchester City Council specification).
13. Lighting columns shall be located to the rear of the footpath or verge, If not possible, the minimum distance for any lighting column to be erected from the kerb face shall be 450mm as per Manchester City Council Standard Detail SL8.
14. Any chosen IDNO shall have a service level agreement in place with Manchester City Council prior to adoption of the installation.
15. IDNO contact details shall also be stored inside the base of each lighting column via means of an identification label.
16. The developer will be responsible, unconditionally, for the condition,operation and any risk or liability of all the highways electrical equipment on all approved works until the date of formal adoption of the street lighting assets.
17. The developer must pay any energy liability charges with their electricity supplier until the adoption of the street lighting assets.

STATUTORY SERVICE NOTES

1. Current statutory service record plans should be obtained by the contractor / overseeing organisation before the commencement of any street lighting installation or removal works.
2. It should be assumed by the contractor that not all services have been identified during the design period. It is the responsibility of the contractor to ensure that all unidentified services are carefully located and reported.
3. The contractor shall identify the location of any overhead electrical or communication equipment prior to the undertaking of any onsite works. Should the presence of such equipment be identified, the contractor shall consult with the relevant statutory undertaker for further guidance.
4. Installation and Removal works should be carried out in accordance with Energy Network Association Technical Specification 43-8, Electricity at Work Regulations 1989, Construction Design and Management (CDM) 2015 & G39/1 and all other relevant Health and Safety Executive regulations.
5. All works in the vicinity of any overhead cables shall conform to the requirements of Health and Safety Executive, Guidance Note GS6 "Avoidance of danger from overhead power lines"
6. All works in the vicinity of underground mains or cables shall conform to the requirements of Health and Safety Executive, Health and Safety Guidance HGS47 "Avoiding danger from underground services" and any additional requirements specified by the relevant undertaker.
7. The contractor will be responsible for liaison with the undertakers and for programming the agreed protection and / or diversion works to any statutory undertakers apparatus into the overall works programme

LIGHTING CLASSIFICATION

This lighting design has been produced in accordance with:
BS 5489-1:2020, CEN/TR 13201-1:2014 & BS EN 13201-2:2015 outdoor lighting documents and guidelines.

Lighting classification: P4 (BS 5489-1:2020,Table A.5)

Minimum average illuminance (Eav): >5.00 lux <7.50 lux
Minimum illuminance (Emin): >1.00 lux
Lighting Uniformity (Emin/Eav): >0.20 (>20%)

The details provided on this drawing are subject to comments by all relevant approving authorities and/or any overseeing organisation. No construction works shall take place until technical approval has been obtained by the approving authority and/or any overseeing organisation.
It is to be understood that these drawings and the information shown are preliminary only and shall not be used for construction. This drawing should not be used for construction or procurement of materials in any way until technical approval is received.
Should the contractor commence work on site prior to obtaining technical approval, then it is entirely at their own risk and no liability shall be accepted by SHD Lighting Consultancy Ltd.

Qty 28 — Proposed galvanised tubular steel lighting column of 6.0 metre nominal height with a planted base as supplied by Mallatite to Manchester City Council street lighting specification.

Column Reference:	B0004/9
Luminaire:	Philips Luma Gen2 Mini
Mounting Type:	Post top mounted at 0° tilt
Manufacturer Reference:	BGP703 DW50 6000 40LED 5.2S CLO L90 740
Lumen Output:	6.00klm
Charge Code:	42 0033 0000 100 (33w)
Colour Temperature:	Neutral White (4000k)
Luminous Intensity:	G3
Control Type:	Philips Citytouch Central Management System (CMS) Node (35/18 lux)
Dimming Profile:	Dimmed to 80% lumen output
Supply:	IDNO with double pole isolation
Secondary Isolator:	Lucy Zodion 32A double pole switch with BS 88 6A HRC fuse to luminaire
Internal Wiring:	1.5mm² flexible artic grade cable
Door Orientation:	Perpendicular to kerb facing away from oncoming vehicles

UNIT IDENTIFICATION KEY:

LC** Proposed lighting column identification number

ELECTRICAL CONNECTION TYPE:

IDNO Independent distribution network operator connection

ISOLUX CONTOUR KEY (AT GROUND LEVEL):


- 0.20 Isolux contour line
- 0.60 Isolux contour line
- 1.00 Isolux contour line
- 2.00 Isolux contour line

REV	DESCRIPTION	DATE	BY
R0	INITIAL DESIGN FOR REVIEW AND COMMENT	08/07/2025	SRH

info@shdlighting.co.uk ☎ 07834 490 192 www.shdlighting.co.uk

SCHEME:	OFF RIVERPARK ROAD, MANCHESTER				
DRAWING:	S38 STREET LIGHTING DESIGN				
CLIENT:	KELLEN HOMES				
DRAWING NUMBER:	SHD2169-SHD-HLG-RIVE-DR-EO-Lighting Layout-R0			DRAWN:	SRH
	SHEET 1 OF 3			CHECKED:	SRH
				APPROVED:	
CONTRACT NUMBER:	SHD2169	DATE:	08/07/2025	SCALE @ A1	1:500
				REVISION:	R0

PRELIMINARY DESIGN - NOT FOR CONSTRUCTION

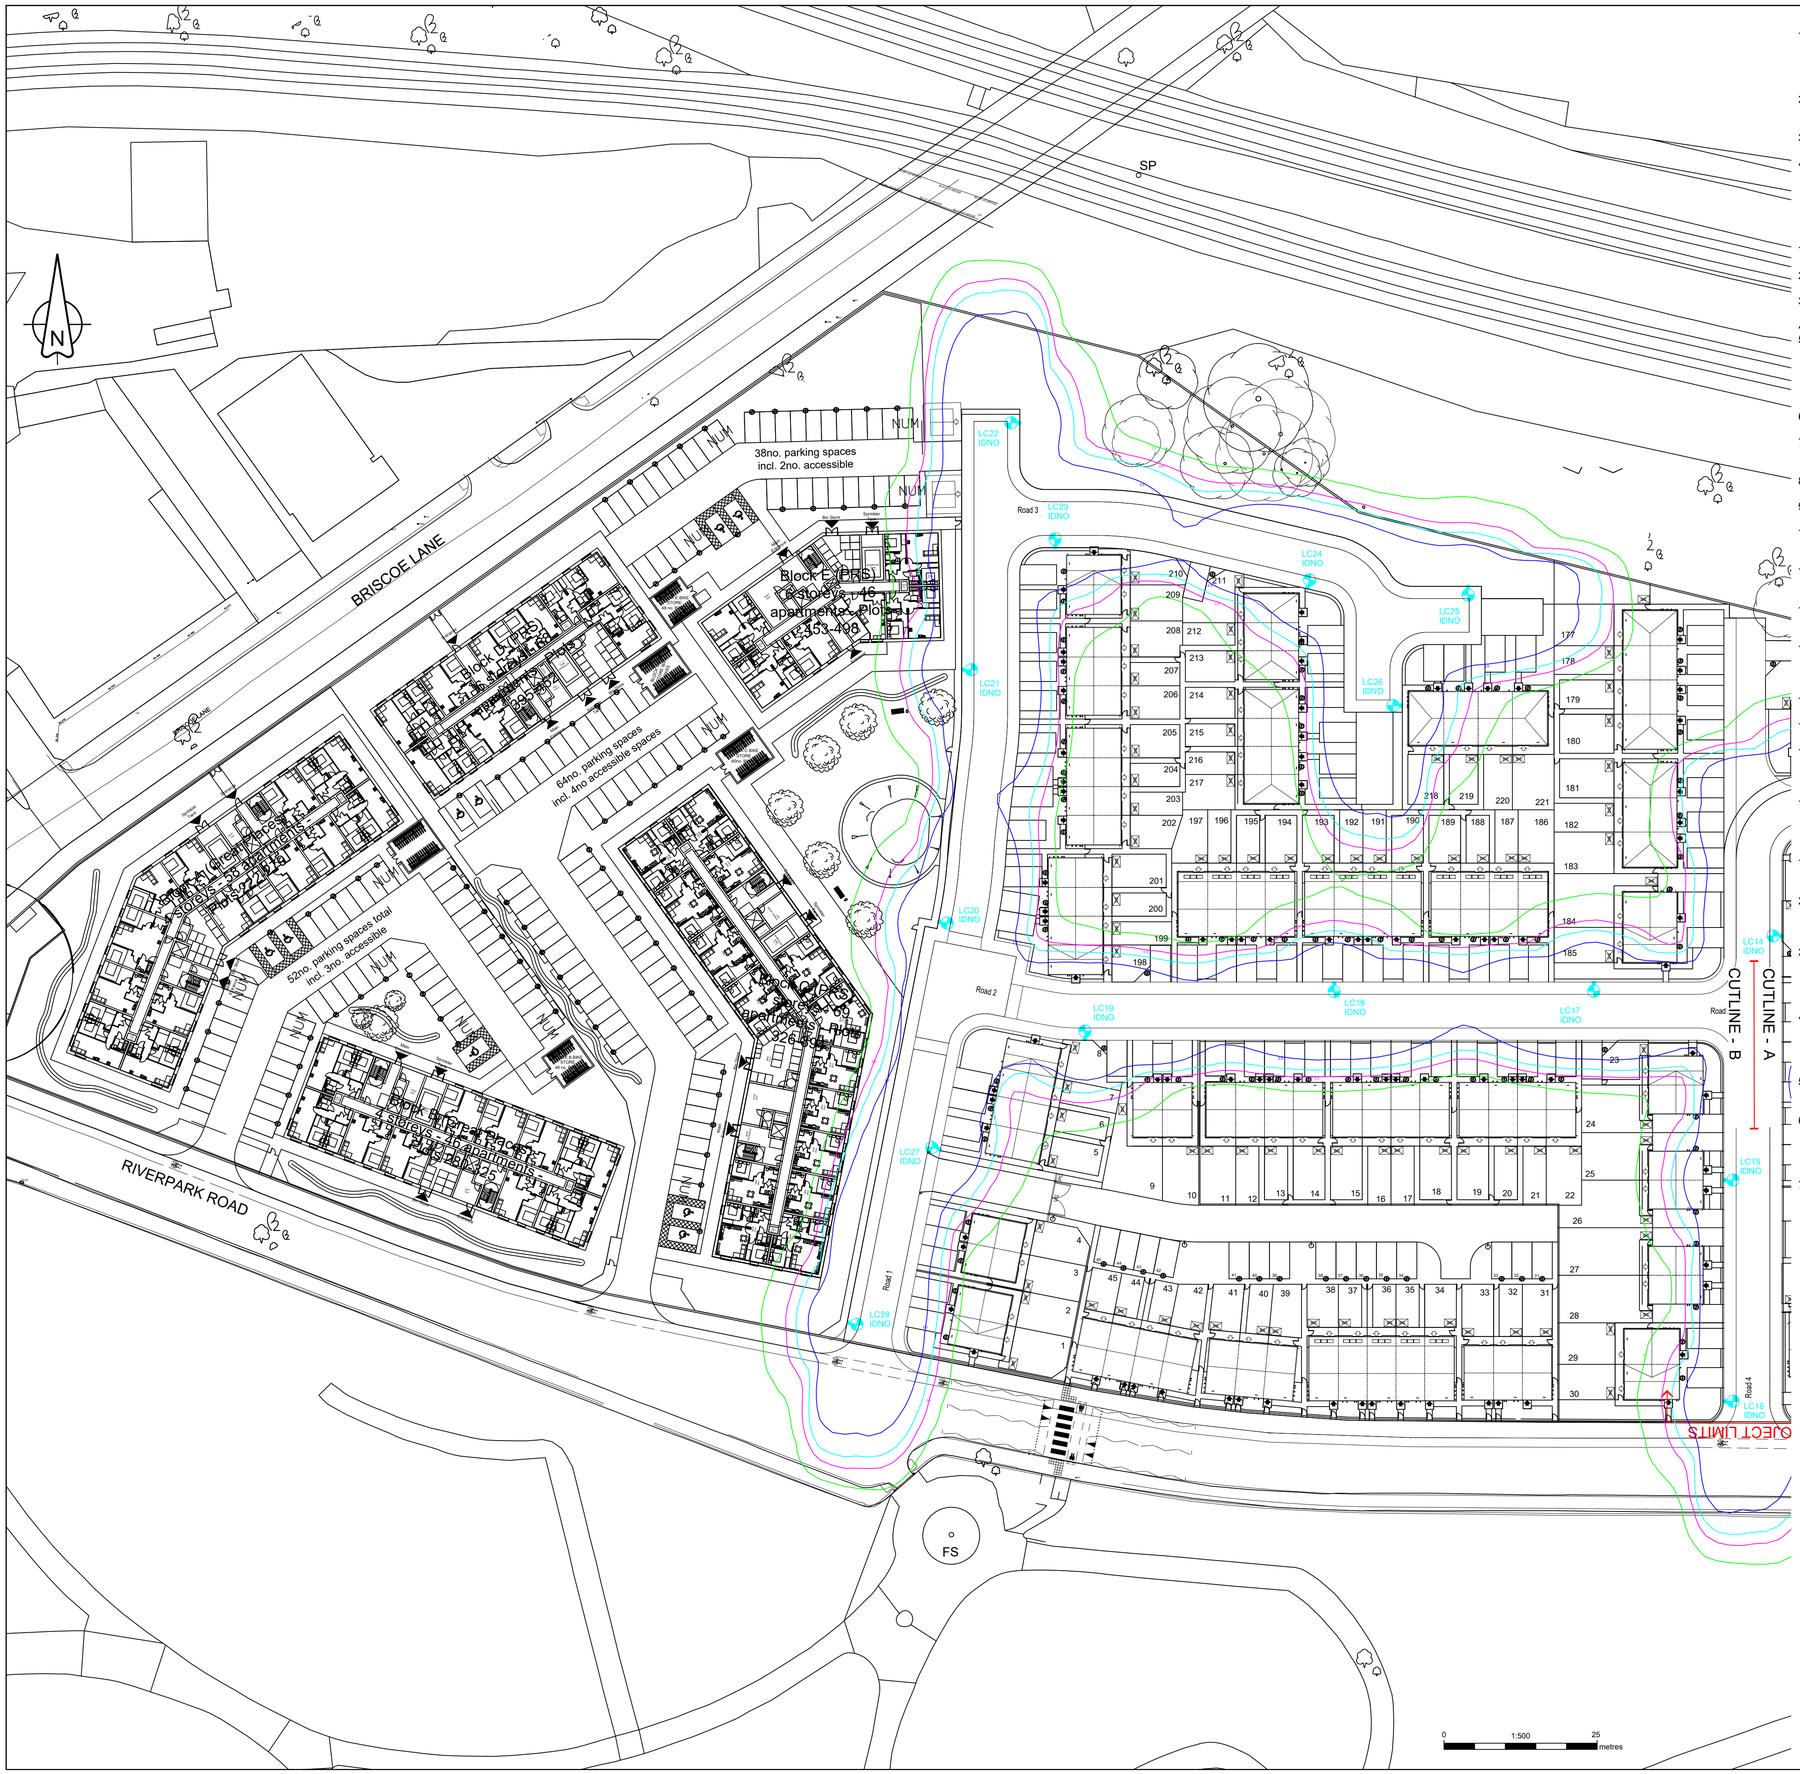

GENERAL NOTES

1. Before construction commences, the site engineer shall ensure that all design information is mutually compatible with all other drawings and documents provided by the overseeing organisation and all drawings and documents are to be read in conjunction with one another.
2. In the event of apparent ambiguity or contradiction, SHD Lighting Consultancy Ltd and the overseeing organisation shall be notified immediately.
3. SHD Lighting Consultancy Ltd accept no liability in the event of not being notified and where construction work has commenced.
4. This lighting design has been prepared in accordance with the HEMSA/HEA Guidance Note - CDM2015 Regulations, Issue 1.1 dated 09/04/15 - Procedure 2 and The Construction (Design and Management) Regulations 2015 - PART 3 Health and safety duties and roles - 9. Duties of designers.

NOTES

1. All works are to be carried out in accordance with the latest Manchester City Council street lighting specification.
2. Any inaccuracies are to be reported to the overseeing organisation or site engineer immediately.
3. The information on this drawing does not account for installation considerations, site conditions or provide any risk assessment.
4. No account is taken for the blocking effect caused by buildings,etc.
5. The planting of trees near to lighting columns is to be avoided as future growth may inhibit lighting levels. Due to the layout of the plots and associated driveways it is inevitable that there will be conflict with proposed landscaping features. Where such instances occur the lighting will take precedence in order to satisfy the requirements of the British standard.
6. The calculation shown by this drawing assumes that the whole area being considered is in the same plane.
7. The contractor shall liaise with the DNO in relation to the programming and coordination of any works associated with the connection and disconnection of street lighting equipment.
8. Final lighting column positions shall be agreed onsite with Manchester City Council street lighting engineer.
9. Final lighting column identification numbers shall be agreed with Manchester City Council street lighting engineer.
10. Any existing or proposed trees are to be cutback, removed or relocated elsewhere to avoid interference with the street lighting luminaire or prevent any future access or maintenance.
11. The contractor shall provide Manchester City Council with as-built drawings, test certificates and column and lantern data sheets in accordance with the Manchester City Council lighting specification.
12. Lighting column foundations shall be designed in accordance with the manufacturer datasheet's for the columns and soil types present (refer to Manchester City Council specification).
13. Lighting columns shall be located to the rear of the footpath or verge, If not possible, the minimum distance for any lighting column to be erected from the kerb face shall be 450mm as per Manchester City Council Standard Detail SL8.
14. Any chosen IDNO shall have a service level agreement in place with Manchester City Council prior to adoption of the installation.
15. IDNO contact details shall also be stored inside the base of each lighting column via means of an identification label.
16. The developer will be responsible, unconditionally, for the condition,operation and any risk or liability of all the highways electrical equipment on all approved works until the date of formal adoption of the street lighting assets.
17. The developer must pay any energy liability charges with their electricity supplier until the adoption of the street lighting assets.

STATUTORY SERVICE NOTES

1. Current statutory service record plans should be obtained by the contractor / overseeing organisation before the commencement of any street lighting installation or removal works.
2. It should be assumed by the contractor that not all services have been identified during the design period. It is the responsibility of the contractor to ensure that all unidentified services are carefully located and reported.
3. The contractor shall identify the location of any overhead electrical or communication equipment prior to the undertaking of any onsite works. Should the presence of such equipment be identified, the contractor shall consult with the relevant statutory undertaker for further guidance.
4. Installation and Removal works should be carried out in accordance with Energy Network Association Technical Specification 43-8, Electricity at Work Regulations 1989, Construction Design and Management (CDM) 2015 & G39/1 and all other relevant Health and Safety Executive regulations.
5. All works in the vicinity of any overhead cables shall conform to the requirements of Health and Safety Executive, Guidance Note GS6 "Avoidance of danger from overhead power lines"
6. All works in the vicinity of underground mains or cables shall conform to the requirements of Health and Safety Executive, Health and Safety Guidance HGS47 "Avoiding danger from underground services" and any additional requirements specified by the relevant undertaker.
7. The contractor will be responsible for liaison with the undertakers and for programming the agreed protection and / or diversion works to any statutory undertakers apparatus into the overall works programme

LIGHTING CLASSIFICATION

This lighting design has been produced in accordance with:
BS 5489-1:2020, CEN/TR 13201-1:2014 & BS EN 13201-2:2015 outdoor lighting documents and guidelines.

Lighting classification: P4 (BS 5489-1:2020,Table A.5)

Minimum average illuminance (Eav): >5.00 lux <7.50 lux
Minimum illuminance (Emin): >1.00 lux
Lighting Uniformity (Emin/Eav): >0.20 (>20%)

Qty 28 — Proposed galvanised tubular steel lighting column of 6.0 metre nominal height with a planted base as supplied by Mallatite to Manchester City Council street lighting specification.

Column Reference:	B0004/9
Luminaire:	Philips Luma Gen2 Mini
Mounting Type:	Post top mounted at 0° tilt
Manufacturer Reference:	BGP703 DW50 6000 40LED 5.2S CLO L90 740
Lumen Output:	6.00klm
Charge Code:	42 0033 0000 100 (33w)
Colour Temperature:	Neutral White (4000k)
Luminous Intensity:	G3
Control Type:	Philips Citytouch Central Management System (CMS) Node (35/18 lux)
Dimming Profile:	Dimmed to 80% lumen output
Supply:	IDNO with double pole isolation
Secondary Isolator:	Lucy Zodion 32A double pole switch with BS 88 6A HRC fuse to luminaire
Internal Wiring:	1.5mm² flexible artic grade cable
Door Orientation:	Perpendicular to kerb facing away from oncoming vehicles

UNIT IDENTIFICATION KEY:

LC** Proposed lighting column identification number

ELECTRICAL CONNECTION TYPE:

IDNO Independent distribution network operator connection

ISOLUX CONTOUR KEY (AT GROUND LEVEL):


- 0.20 Isolux contour line
- 0.60 Isolux contour line
- 1.00 Isolux contour line
- 2.00 Isolux contour line

REV	DESCRIPTION	DATE	BY
R0	INITIAL DESIGN FOR REVIEW AND COMMENT	08/07/2025	SRH

info@shdlighting.co.uk ☎ 07834 490 192 www.shdlighting.co.uk

SCHEME:	OFF RIVERPARK ROAD, MANCHESTER
DRAWING:	S38 STREET LIGHTING DESIGN
CLIENT:	KELLEN HOMES
DRAWING NUMBER:	SHD2169-SHD-XLG-RIVE-DR-EO-Lighting Layout-R0
	SHEET 2 OF 3
DRAWN:	SRH
CHECKED:	SRH
APPROVED:	
CONTRACT NUMBER:	SHD2169
DATE:	08/07/2025
SCALE @ A1	1:500
REVISION:	R0

PRELIMINARY DESIGN - NOT FOR CONSTRUCTION

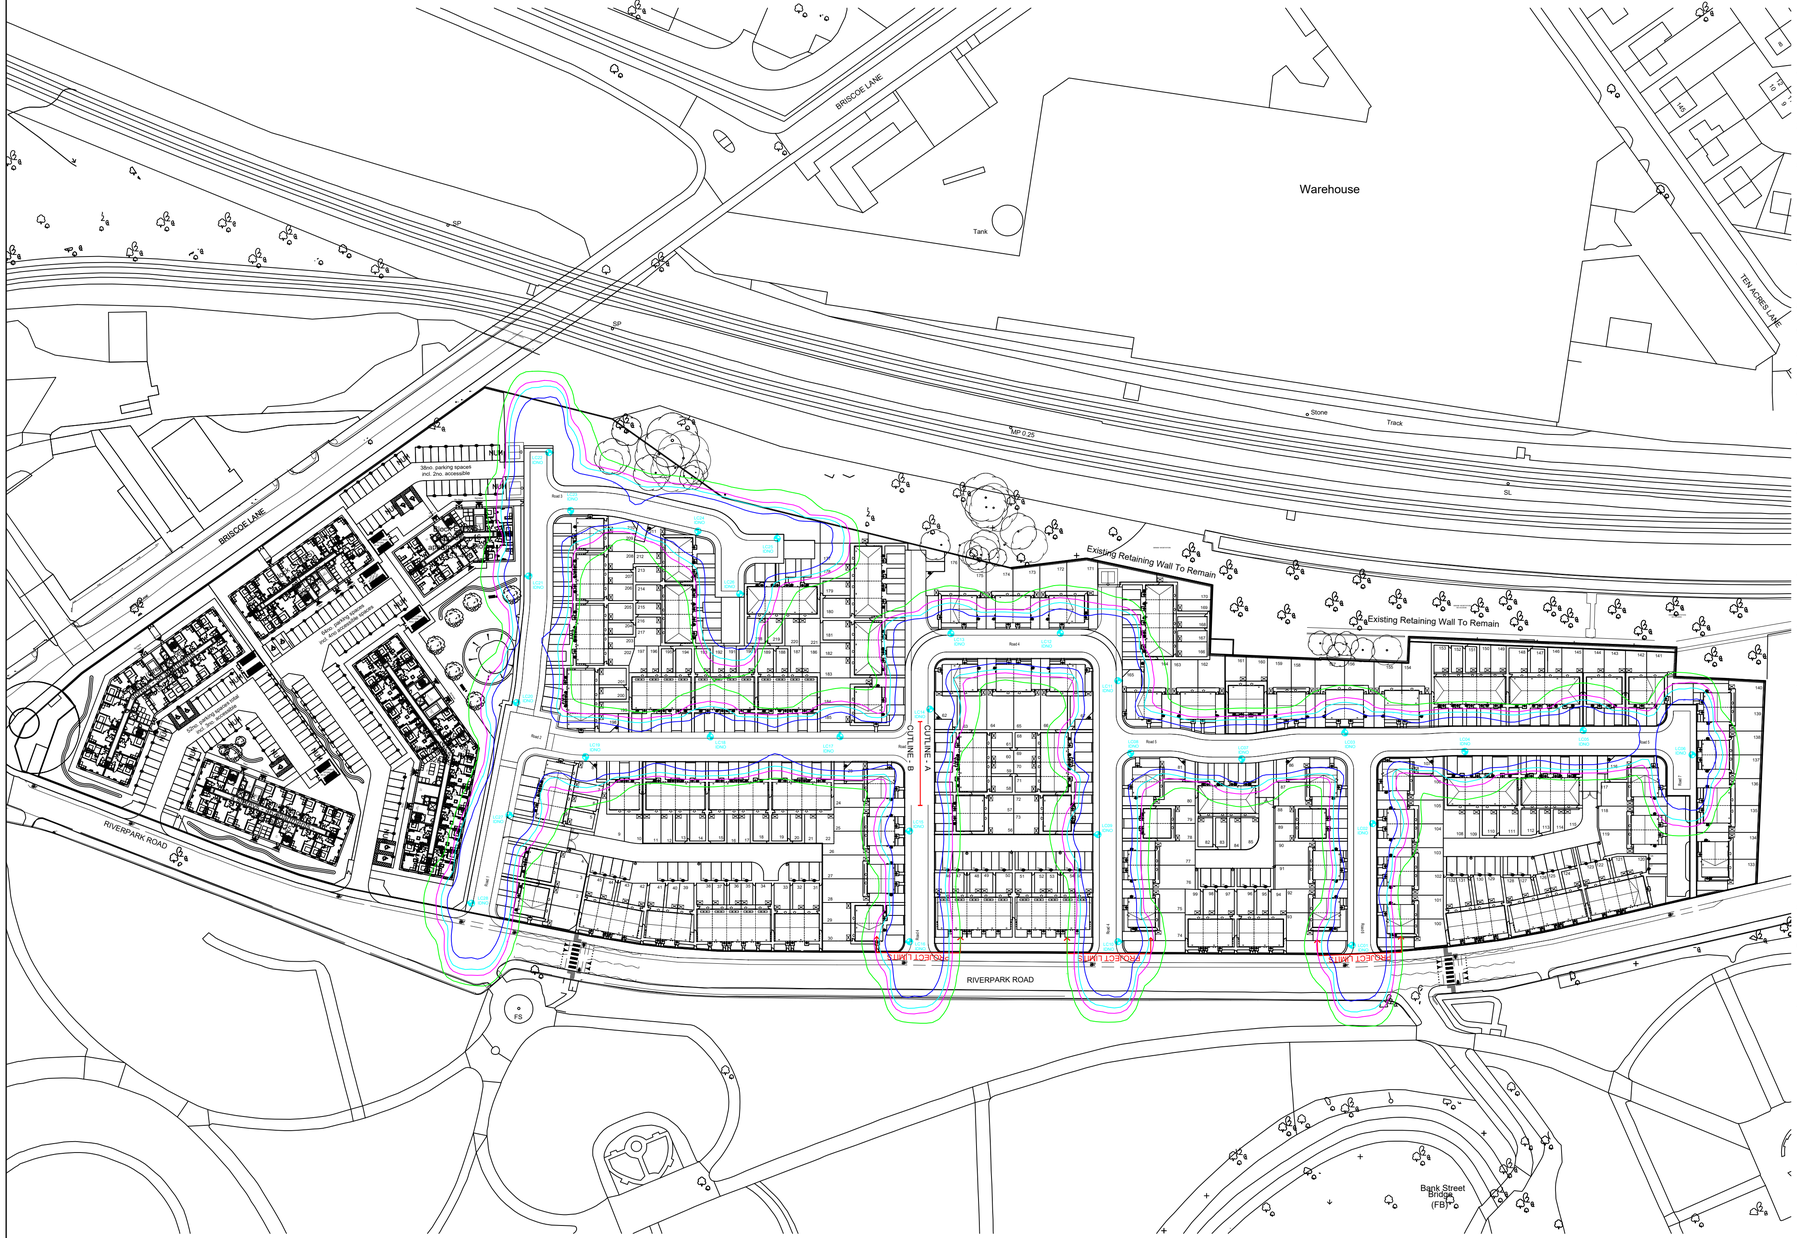

GENERAL NOTES

1. Before construction commences, the site engineer shall ensure that all design information is mutually compatible with all other drawings and documents provided by the overseeing organisation and all drawings and documents are to be read in conjunction with one another.
2. In the event of apparent ambiguity or contradiction, SHD Lighting Consultancy Ltd and the overseeing organisation shall be notified immediately.
3. SHD Lighting Consultancy Ltd accept no liability in the event of not being notified and where construction work has commenced.
4. This lighting design has been prepared in accordance with the HEMSA/HEA Guidance Note - CDM2015 Regulations, Issue 1.1 dated 09/04/15 - Procedure 2 and The Construction (Design and Management) Regulations 2015 - PART 3 Health and safety duties and roles - 9. Duties of designers.

NOTES

1. All works are to be carried out in accordance with the latest Manchester City Council street lighting specification.
2. Any inaccuracies are to be reported to the overseeing organisation or site engineer immediately.
3. The information on this drawing does not account for installation considerations, site conditions or provide any risk assessment.
4. No account is taken for the blocking effect caused by buildings,etc.
5. The planting of trees near to lighting columns is to be avoided as future growth may inhibit lighting levels. Due to the layout of the plots and associated driveways it is inevitable that there will be conflict with proposed landscaping features. Where such instances occur the lighting will take precedence in order to satisfy the requirements of the British standard.
6. The calculation shown by this drawing assumes that the whole area being considered is in the same plane.
7. The contractor shall liaise with the DNO in relation to the programming and coordination of any works associated with the connection and disconnection of street lighting equipment.
8. Final lighting column positions shall be agreed onsite with Manchester City Council street lighting engineer.
9. Final lighting column identification numbers shall be agreed with Manchester City Council street lighting engineer.
10. Any existing or proposed trees are to be cutback, removed or relocated elsewhere to avoid interference with the street lighting luminaire or prevent any future access or maintenance.
11. The contractor shall provide Manchester City Council with as-built drawings, test certificates and column and lantern data sheets in accordance with the Manchester City Council lighting specification.
12. Lighting column foundations shall be designed in accordance with the manufacturer datasheet's for the columns and soil types present (refer to Manchester City Council specification).
13. Lighting columns shall be located to the rear of the footpath or verge, If not possible, the minimum distance for any lighting column to be erected from the kerb face shall be 450mm as per Manchester City Council Standard Detail SL8.
14. Any chosen IDNO shall have a service level agreement in place with Manchester City Council prior to adoption of the installation.
15. IDNO contact details shall also be stored inside the base of each lighting column via means of an identification label.
16. The developer will be responsible, unconditionally, for the condition,operation and any risk or liability of all the highways electrical equipment on all approved works until the date of formal adoption of the street lighting assets.
17. The developer must pay any energy liability charges with their electricity supplier until the adoption of the street lighting assets.

STATUTORY SERVICE NOTES

1. Current statutory service record plans should be obtained by the contractor / overseeing organisation before the commencement of any street lighting installation or removal works.
2. It should be assumed by the contractor that not all services have been identified during the design period. It is the responsibility of the contractor to ensure that all unidentified services are carefully located and reported.
3. The contractor shall identify the location of any overhead electrical or communication equipment prior to the undertaking of any onsite works. Should the presence of such equipment be identified, the contractor shall consult with the relevant statutory undertaker for further guidance.
4. Installation and Removal works should be carried out in accordance with Energy Network Association Technical Specification 43-8, Electricity at Work Regulations 1989, Construction Design and Management (CDM) 2015 & G39/1 and all other relevant Health and Safety Executive regulations.
5. All works in the vicinity of any overhead cables shall conform to the requirements of Health and Safety Executive, Guidance Note GS6 "Avoidance of danger from overhead power lines"
6. All works in the vicinity of underground mains or cables shall conform to the requirements of Health and Safety Executive, Health and Safety Guidance HGS47 "Avoiding danger from underground services" and any additional requirements specified by the relevant undertaker.
7. The contractor will be responsible for liaison with the undertakers and for programming the agreed protection and / or diversion works to any statutory undertakers apparatus into the overall works programme

LIGHTING CLASSIFICATION

This lighting design has been produced in accordance with:
BS 5489-1:2020, CEN/TR 13201-1:2014 & BS EN 13201-2:2015 outdoor lighting documents and guidelines.

Lighting classification: P4 (BS 5489-1:2020,Table A.5)

Minimum average illuminance (Eav): >5.00 lux <7.50 lux
Minimum illuminance (Emin): >1.00 lux
Lighting Uniformity (Emin/Eav): >0.20 (>20%)

Qty 28 — Proposed galvanised tubular steel lighting column of 6.0 metre nominal height with a planted base as supplied by Mallatite to Manchester City Council street lighting specification.

Column Reference:	B0004/9
Luminaire:	Philips Luma Gen2 Mini
Mounting Type:	Post top mounted at 0° tilt
Manufacturer Reference:	BGP703 DW50 6000 40LED 5.2S CLO L90 740
Lumen Output:	6.00klm
Charge Code:	42 0033 0000 100 (33w)
Colour Temperature:	Neutral White (4000k)
Luminous Intensity:	G3
Control Type:	Philips Citytouch Central Management System (CMS) Node (35/18 lux)
Dimming Profile:	Dimmed to 80% lumen output
Supply:	IDNO with double pole isolation
Secondary Isolator:	Lucy Zodion 32A double pole switch with BS 88 6A HRC fuse to luminaire
Internal Wiring:	1.5mm² flexible artic grade cable
Door Orientation:	Perpendicular to kerb facing away from oncoming vehicles

UNIT IDENTIFICATION KEY:

LC** Proposed lighting column identification number

ELECTRICAL CONNECTION TYPE:

IDNO Independent distribution network operator connection

ISOLUX CONTOUR KEY (AT GROUND LEVEL):

- 0.20 Isolux contour line
- 0.60 Isolux contour line
- 1.00 Isolux contour line
- 2.00 Isolux contour line

REV	DESCRIPTION	DATE	BY
R0	INITIAL DESIGN FOR REVIEW AND COMMENT	08/07/2025	SRH

SHD
info@shdlighting.co.uk ☎ 07834 490 192 www.shdlighting.co.uk

SCHEME:	OFF RIVERPARK ROAD, MANCHESTER
DRAWING:	S38 STREET LIGHTING DESIGN
CLIENT:	KELLEN HOMES
DRAWING NUMBER:	SHD2169-SHD-HLG-RIVE-DR-EO-Lighting Layout-R0
	SHEET 3 OF 3
DRAWN:	SRH
CHECKED:	SRH
APPROVED:	
CONTRACT NUMBER:	SHD2169
DATE:	08/07/2025
SCALE @ A1	1:100
REVISION:	R0

PRELIMINARY DESIGN - NOT FOR CONSTRUCTION